


Datasheet


50 mm Multicolor RGB Devices (Indicator, Touch Button, Push Button, Optical Sensor, and Beacon)

This datasheet contains limited information on K50 Pro Devices with PICK-IQ™. For complete information on configuration, performance, troubleshooting, dimensions, and accessories, please refer to the PICK-IQ™ Devices Instruction Manual. Go to www.bannerengineering.com and search 206185 to view the PICK-IQ™ Devices Instruction Manual or 209995 to view the Device Register Map. Use of this document assumes familiarity with pertinent industry standards and practices.


- PICK-IQ gives full access to color, flashing, rotating, and dimming settings as well as advanced animations such as dynamic sequence mode and LED control
- Output settings, including on and off delays, output function, and output state are also available with PICK-IQ
- PICK-IQ brings faster response speed and simplified programming to Modbus RTU communication




Indicator




Optical Sensor



Touch Button



Push Button



Beacon




WARNING:

- **Do not use this device for personnel protection**
- Using this device for personnel protection could result in serious injury or death.
- This device does not include the self-checking redundant circuitry necessary to allow its use in personnel safety applications. A device failure or malfunction can cause either an energized (on) or de-energized (off) output condition.

Models


Touch Button Models

- Excellent immunity to false triggering by water spray, oils, and other foreign materials
- Rated IEC IP67 and IP69K per DIN 40050-9
- Can be actuated with bare hands or gloves; adjustable sensitivity

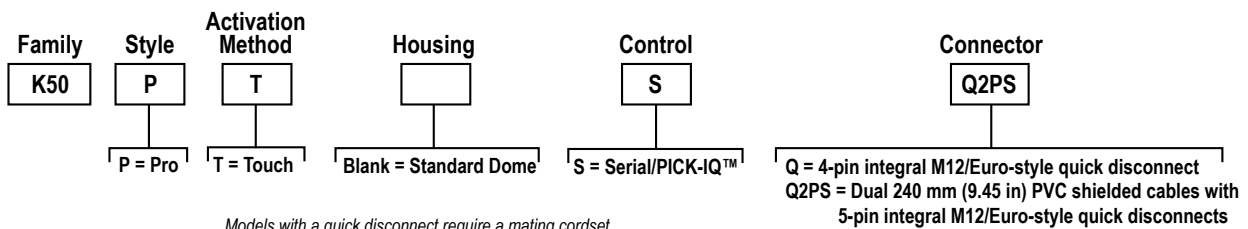

Push Button and Optical Sensor Models

- Optical sensor models are immune to ambient light, EMI and RFI interference
- Optical sensor models rated IEC IP67 and IP69K per DIN 40050-9
- Push Button models rated IEC IP65

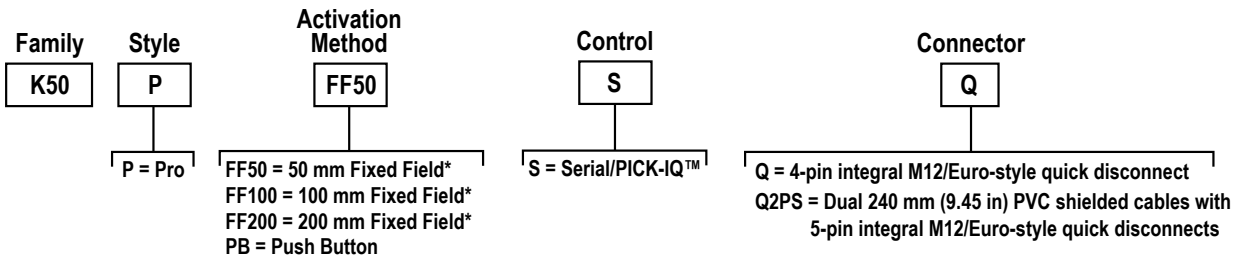


*Cutoff distance will vary from specified range based on target and tolerances

Models with a quick disconnect require a mating cordset

Indicator Models



- Bright, uniform indicator light
- Rated IEC IP67 and IP69K per DIN 40050-9


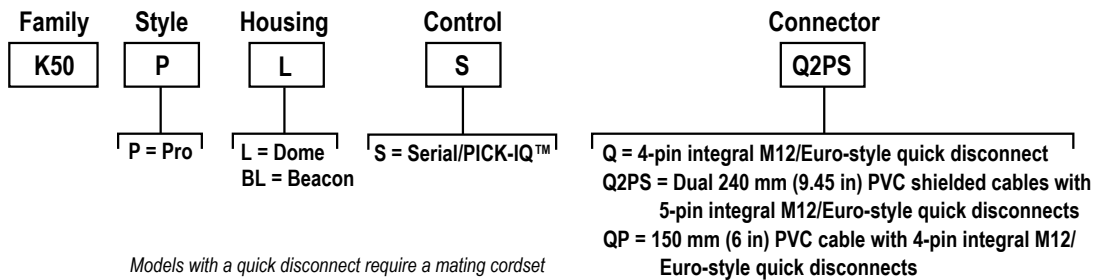


Models with a quick disconnect require a mating cordset

Wiring

Compatible cordsets can be found in the PICK-IQ™ Devices Instruction Manual (206185).

Wiring for the Q Models					
4-pin M12/Euro-style Male	4-pin M12/Euro-style Female	Pin	Wire Color	Connection	
		1	brown	10 V DC to 30 V DC	
		3	blue	DC common	
		4	black	RS-485 (-)	
		2	white	RS-485 (+)	

Wiring for the Q2PS Models					
5-pin M12/Euro-style Male	5-pin M12/Euro-style Female	Pin	Wire Color	Connection	
		1	brown	10 V DC to 30 V DC	
		3	blue	DC common	
		4	black	RS-485 (-)	
		2	white	RS-485 (+)	
		5	gray	Shield	

Specifications

Supply Voltage

10 V DC to 30 V DC

Supply Current

210 mA maximum current at 10 V DC
 Touch Models: 55 mA typical at 24 V DC
 Optical Models: 70 mA typical at 24 V DC
 Push Button/Indicator Models: 55 mA typical at 24 V DC

Supply Protection Circuitry

Protected against reverse polarity and transient voltages

Touch Dwell Time

If touch dwells for longer than 60 seconds, the output will revert to the untouched state

Touch Response Time

Input Response: 5 ms minimum
 Touch Response: 300 ms maximum (Standard Sensitivity touch response)

Optical Sensor Emitter LED

Infrared 870 nm

Operating Conditions

-40 °C to +50 °C (-40 °F to +122 °F)
Humidity: 90% at +50 °C maximum relative humidity (non-condensing)
Storage: -40 °C to +70 °C (-40 °F to +158 °F)

Environmental Rating

Beacon, Touch, Indicator, and Optical Models: IEC IP67, IP69K per DIN 40050-9
 Push Button Models: IEC IP65

Certifications



Mounting

M30 × 1.5 threaded base, maximum torque 4.5 N·m (40 in·lbf)

Construction

Base, Dome, and Nut: Polycarbonate
 Push Button: Thermoplastic

Vibration and Mechanical Shock

Meets IEC 60068-2-6 requirements (Vibration: 10 Hz to 55 Hz, 1.0 mm amplitude, 5 minutes sweep, 30 minutes dwell)
 Meets IEC 60068-2-27 requirements (Shock: 30G 11 ms duration, half sine wave)

Connections

Integral 4-pin M12/Euro-style quick disconnect or dual 240 mm (9.4 in), shielded PVC cables with 5-pin M12/Euro-style quick disconnects, depending on model
 Models with a quick disconnect require a mating cordset

Required Overcurrent Protection



WARNING: Electrical connections must be made by qualified personnel in accordance with local and national electrical codes and regulations.

Overcurrent protection is required to be provided by end product application per the supplied table.
 Overcurrent protection may be provided with external fusing or via Current Limiting, Class 2 Power Supply.

Supply wiring leads < 24 AWG shall not be spliced.

For additional product support, go to www.bannerengineering.com.

Supply Wiring (AWG)	Required Overcurrent Protection (Amps)
20	5.0
22	3.0
24	2.0
26	1.0
28	0.8
30	0.5

Default Indicator Characteristics

Color	Dominant Wavelength (nm) or Color Temperature (CCT)	Color Coordinates ²		Lumen Output (Typical at 25 °C)		
		x	y	Touch Button Models ³	Indicator Models	Beacon Models
Green	522	0.154	0.700	16.5	23	15.3
Red	620	0.689	0.309	8.3	7.2	6.8
Yellow	576	0.477	0.493	23.8	18	17.2
Blue	466	0.140	0.054	4.6	5.2	3.3
White	5700K	0.328	0.337	25.1	21.7	20.9
Cyan	493	0.170	0.340	18.4	26.2	17.0
Magenta	-	0.379	0.172	11.1	9.3	8.6
Amber	589	0.556	0.420	15.7	13	12.6
Rose	-	0.515	0.220	9.1	7.9	7.7
Lime Green	562	0.388	0.561	21.4	27.9	20.4
Sky Blue	486	0.155	0.247	19.5	28	17.9
Orange	599	0.616	0.370	12.1	10.2	12.6
Violet	-	0.217	0.089	9.7	10.7	6.7
Spring Green	508	0.177	0.536	17	24.1	15.8

¹ Q2PS models must be installed to protect the cable and cable entrance from high-pressure spray to meet IP69K.


² Refer to the CIE 1931 (x,y) Chromaticity Diagram to show equivalent color with indicated color coordinates. Actual coordinates may differ ± 5%.

³ Values shown apply to touch dome models only. Lumen output for optical sensor models is 14% lower and push button models is 10% lower.


Dimensions

All measurements are listed in millimeters [inches], unless noted otherwise. Compatible brackets can be found in the PICK-IQ™ Devices Instruction Manual (206185).


Touch Button

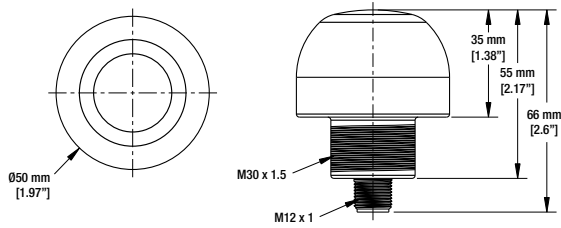


Indicator

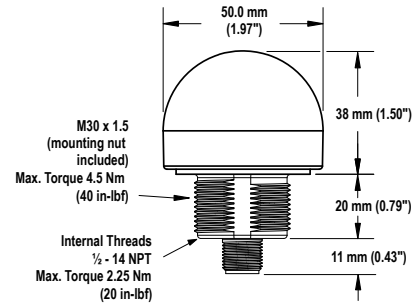


Push Button

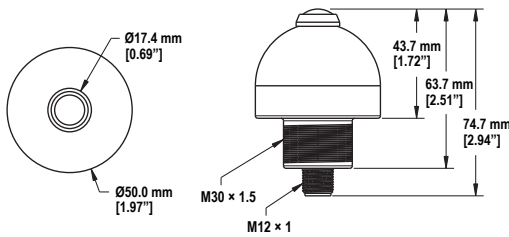


Optical Sensor

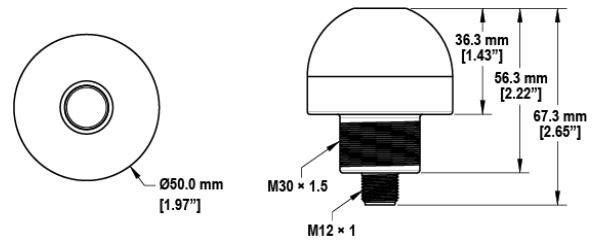

Beacon

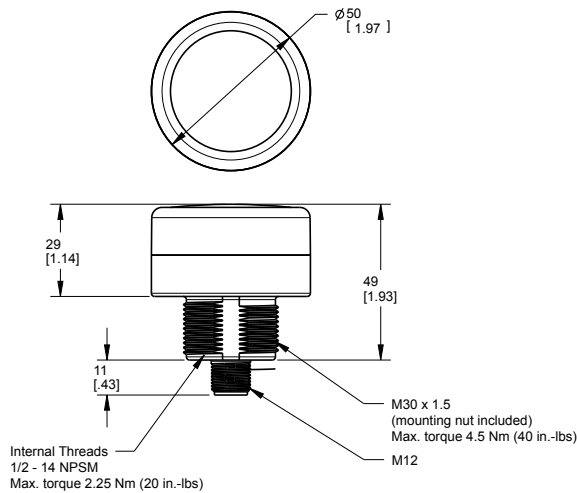

Dual M12/Euro-style Cable

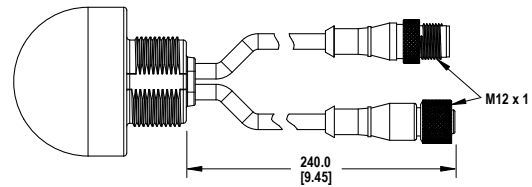

Note: The splitter cordset dimensions are functionally identical for all K50 devices; the K50 Indicator is shown.

Banner Engineering Corp. Limited Warranty

Banner Engineering Corp. warrants its products to be free from defects in material and workmanship for one year following the date of shipment. Banner Engineering Corp. will repair or replace, free of charge, any product of its manufacture which, at the time it is returned to the factory, is found to have been defective during the warranty period. This warranty does not cover damage or liability for misuse, abuse, or the improper application or installation of the Banner product.

THIS LIMITED WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER EXPRESS OR IMPLIED (INCLUDING, WITHOUT LIMITATION, ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE), AND WHETHER ARISING UNDER COURSE OF PERFORMANCE, COURSE OF DEALING OR TRADE USAGE.

This Warranty is exclusive and limited to repair or, at the discretion of Banner Engineering Corp., replacement. **IN NO EVENT SHALL BANNER ENGINEERING CORP. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR ANY EXTRA COSTS, EXPENSES, LOSSES, LOSS OF PROFITS, OR ANY INCIDENTAL, CONSEQUENTIAL OR SPECIAL DAMAGES RESULTING FROM ANY PRODUCT DEFECT OR FROM THE USE OR INABILITY TO USE THE PRODUCT, WHETHER ARISING IN CONTRACT OR WARRANTY, STATUTE, TORT, STRICT LIABILITY, NEGLIGENCE, OR OTHERWISE.**

Banner Engineering Corp. reserves the right to change, modify or improve the design of the product without assuming any obligations or liabilities relating to any product previously manufactured by Banner Engineering Corp. Any misuse, abuse, or improper application or installation of this product or use of the product for personal protection applications when the product is identified as not intended for such purposes will void the product warranty. Any modifications to this product without prior express approval by Banner Engineering Corp will void the product warranties. All specifications published in this document are subject to change; Banner reserves the right to modify product specifications or update documentation at any time. Specifications and product information in English supersede that which is provided in any other language. For the most recent version of any documentation, refer to: www.bannerengineering.com.

For patent information, see www.bannerengineering.com/patents.

FCC Part 15 and CAN ICES-3 (B)/NMB-3(B)

This device complies with part 15 of the FCC Rules and CAN ICES-3 (B)/NMB-3(B). Operation is subject to the following two conditions:

1. This device may not cause harmful interference, and
2. This device must accept any interference received, including interference that may cause undesired operation.

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules and CAN ICES-3 (B)/NMB-3(B). These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the manufacturer.