

GS60 Pro Multicolor Guide Spotlight Product Manual



Original Instructions

p/n: 243622 Rev. B

14-Apr-25

© Banner Engineering Corp. All rights reserved. www.bannerengineering.com

Contents


Chapter 1 Features	3
Model Key	3
Chapter 2 Wiring.....	4
Chapter 3 Pro Editor	5
Full Preview Connection (Required)	5
Pro Editor Configuration for the GS60 Pro	6
Discrete Control	6
Pulse Control	7
Chapter 4 Specifications	9
FCC Part 15 Class B for Unintentional Radiators.....	10
Industry Canada ICES-003(B).....	10
Dimensions	11
Optical Data	12
Chapter 5 Accessories.....	14
Cordsets	14
Mounting Accessories.....	14
Power Supplies.....	16
Chapter 6 Product Support and Maintenance	17
Clean with Mild Detergent and Water	17
Repairs	17
Contact Us.....	17
Banner Engineering Corp Limited Warranty	17
Mexican Importer	17

Chapter Contents

Model Key 3

Chapter 1

Features



- 12 V DC to 30 V DC operation
- 60 mm diameter and 30 mm mounting base
- Rugged sealed housing rated to IP66 and IP67
- Cooling rib design for thermal management when used at the highest output for an extended period of time
- Seven default colors in one device (Green, Red, Yellow, Blue, White, Cyan, Magenta)

IMPORTANT: Read the following instructions before operating the light. Please download the complete GS60 Pro Multicolor Guide Spotlight technical documentation, available in multiple languages, from www.bannerengineering.com for details on the proper use, applications, Warnings, and installation instructions of this device.

IMPORTANT: Lea el siguiente instructivo antes de operar el luminario. Por favor descargue desde www.bannerengineering.com toda la documentación técnica de los GS60 Pro Multicolor Guide Spotlight, disponibles en múltiples idiomas, para detalles del uso adecuado, aplicaciones, advertencias, y las instrucciones de instalación de estos dispositivos.

IMPORTANT: Lisez les instructions suivantes avant d'utiliser le luminaire. Veuillez télécharger la documentation technique complète des GS60 Pro Multicolor Guide Spotlight sur notre site www.bannerengineering.com pour les détails sur leur utilisation correcte, les applications, les notes de sécurité et les instructions de montage.

Model Key

Housing	Color	Lens Angle	Control	Connection
GS60P	RGBW	L9		Q
60 mm diameter Pro-enabled Guide Spotlight	RGBW = Multicolor	9 = ± 9 degree lens	Blank = Constant power plus three inputs	Q = Integral 5-pin M12 male quick-disconnect connector

CAUTION:

Risk Group 2: Possibly hazardous optical radiation emitted from this product.





Do not stare at the operating lamp. May be harmful to the eyes. Risk Group 2 (RG 2) products generally do not pose a realistic optical hazard if aversion responses limit the exposure duration or where lengthy exposures are unrealistic.

- IEC 62471

Chapter Contents

Chapter 2

Wiring

Diagram	Pinout	Pin Number	Wire Color	Description
		Pin 1	Brown	12 V DC to 30 V DC
		Pin 2	White	Input 2: 12 V DC to 30 V DC
		Pin 3	Blue	DC common
		Pin 4	Black	Input 1: 12 V DC to 30 V DC
		Pin 5	Gray	Input 3: 12 V DC to 30 V DC

Default Color Definition

	Red	Yellow	Green	Cyan	Blue	Magenta	White
Input 1	X	X				X	X
Input 2		X	X	X			X
Input 3				X	X	X	X


An "X" denotes an active input. For example, when Input 1 and Input 3 are active, the spotlight is magenta.

Chapter Contents

Full Preview Connection (Required).....	5
Pro Editor Configuration for the GS60 Pro	6

Chapter 3

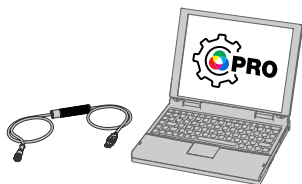
Pro Editor



Use Banner's Pro Editor software and Pro Converter Cable to create custom configurations by selecting different colors, flash patterns, and animations. For more information visit www.bannerengineering.com/proeditor.


Full Preview Connection (Required)

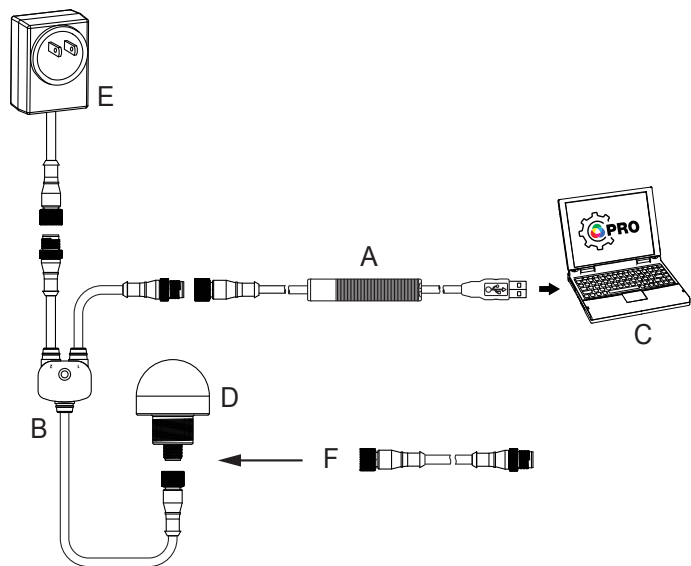The full preview connection must be used for the GS60 Pro Multicolor Guide Spotlight.



- A = Pro Converter Cable (MQDC-506-USB)
- B = Splitter (CSB-M1251FM1251M)
- C = PC running Pro Editor software
- D = Any Banner Pro Series-enabled device (K50 shown)
- E = Power Supply (PSW-24-1, PSW-24-2, or PSD-24-4)
- F = 8-Pin to 5-Pin Double-Ended Cordset (MQDC-801-5M-PRO), required for 8-Pin models

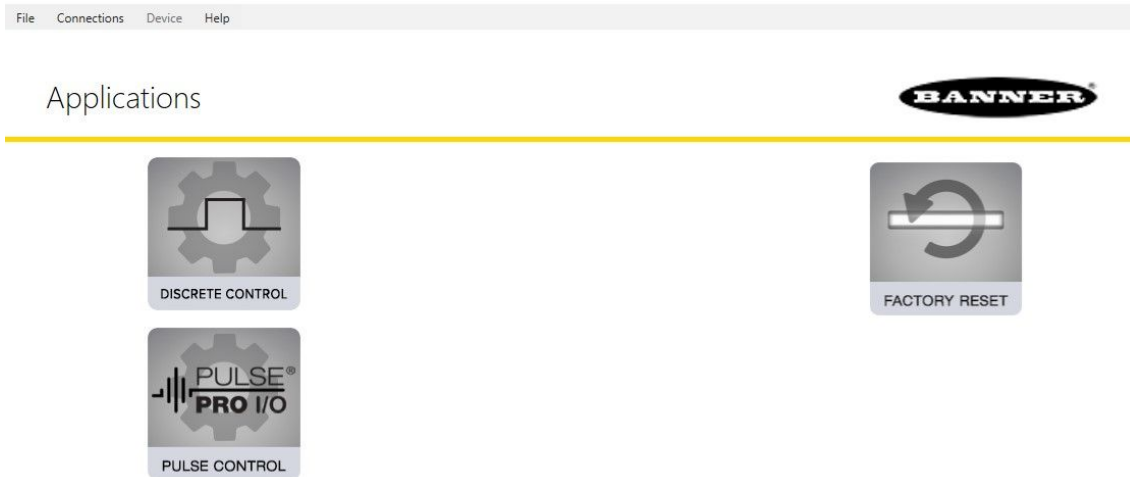Pro Editor Configuration for the GS60 Pro



Banner's Pro Editor software offers an easy way to configure Pro Series-enabled indication, touch, and illumination devices, allowing users full control of device states and device logic modes. The easy-to-use configuration software provides a variety of tools and capabilities to solve a wide range of applications such as indicating machine status or warm-up time, indicating unique steps in an assembly process, or incorporating status information into touch buttons.

Setup any Pro Series-enabled device using the free Pro Editor software, available for download at www.bannerengineering.com/proeditor.

Discrete Control

Selecting the Discrete Control tile displays three I/O State tiles:

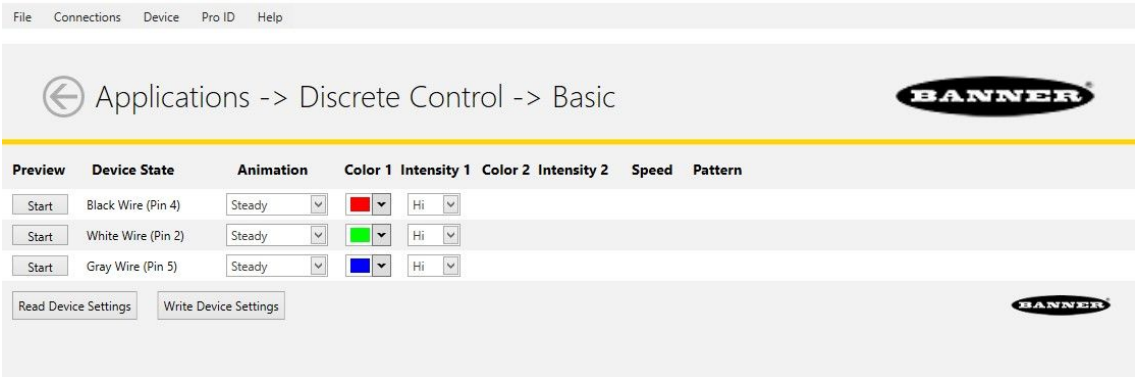
- Basic
- Advanced
- I/O Block



Basic I/O State


Basic three-state control. Configurations made in Basic I/O State assign one wire to one state, with the following override control:

- Pin 1 (Brown) overrides Pin 4 (Black)
- Pin 2 (White) overrides Pins 1 and 4 (Brown and Black)
- Pin 5 (Gray) overrides Pins 1, 2, and 4 (Brown, White, and Black)




Advanced I/O State

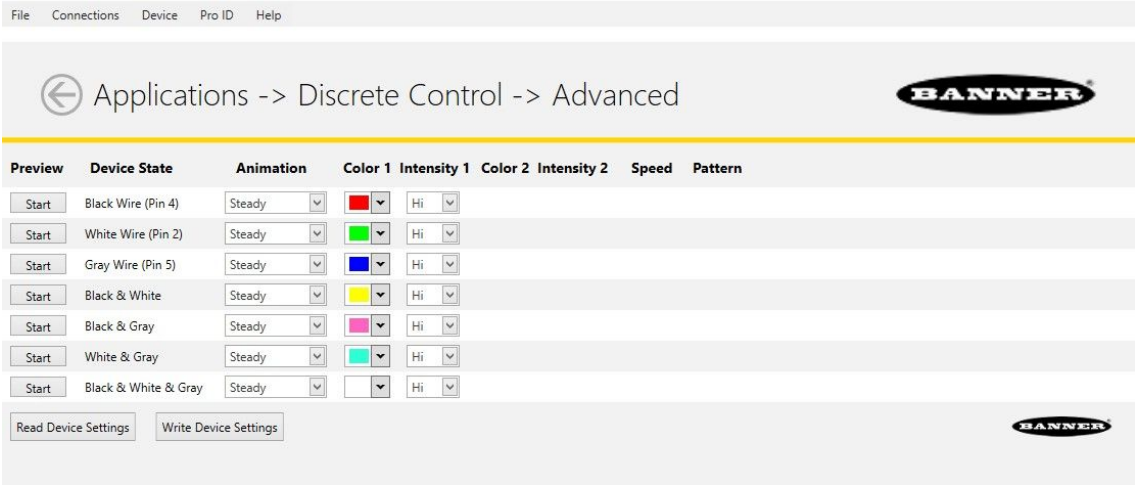Advanced, default I/O state, with seven state options for maximum configuration ability. Configurations made in Advanced I/O State assign binary wiring combinations of all valid inputs to each state.



I/O Block I/O State

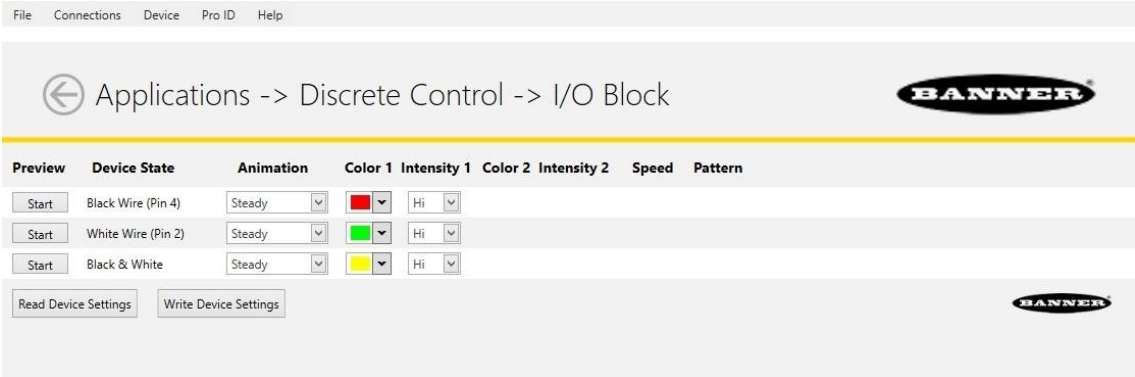Three-state control for use with I/O block. Configurations made in I/O Block assign state to the black, white, and combination of black and white wires for use with the I/O blocks, for which power (brown) and common (blue) are always on for five-pin connections.



Pulse Control

Selecting the Pulse Control tile displays up to sixteen states that correspond to input frequencies on the white wire. The number of states (1) and input characteristics (2) are user-defined. Ranges are calculated (3).

FileConnectionsDeviceHelp

Applications -> Pulse Control

BANNER

Number of States: 16

PWM/PFM: PFM

PFM Low: 100

PFM High: 600

Preview	State	Animation	Color 1	Intensity 1	Color 2	Intensity 2	Color1%	Speed	Pattern	Direction	Range (Hz)
Start	1	Off									100 - 131
Start	2	Steady		Hi							131 - 163
Start	3	Steady		Hi							163 - 194
Start	4	Steady		Hi							194 - 225
Start	5	Steady		Hi							225 - 256
Start	6	Steady		Hi							256 - 288
Start	7	Steady		Hi							288 - 319
Start	8	Steady		Hi							319 - 350
Start	9	Off									350 - 381
Start	10	Flash		Hi				Stanc	Norm		381 - 413
Start	11	Flash		Hi				Stanc	Norm		413 - 444
Start	12	Flash		Hi				Stanc	Norm		444 - 475
Start	13	Flash		Hi				Stanc	Norm		475 - 506
Start	14	Flash		Hi				Stanc	Norm		506 - 538
Start	15	Flash		Hi				Stanc	Norm		538 - 569
Start	16	Flash		Hi				Stanc	Norm		569 - 600

Chapter Contents

FCC Part 15 Class B for Unintentional Radiators	10
Industry Canada ICES-003(B).....	10
Dimensions.....	11
Optical Data.....	12

Chapter 4 Specifications

Supply Voltage

12 V DC to 30 V DC

Use only with a suitable Class 2 power supply (UL) or SELV power supply (CE)

See the electrical characteristics on the product label.

Supply Current

Typical Current			Maximum Current
12 V DC	24 V DC	30 V DC	A
0.415	0.2	0.165	0.5

Supply Protection Circuitry

Protected against reverse polarity and transient voltages

Light Source

One high-intensity LED; see models table for color temperature or wavelengths

Construction

Black anodized aluminum housing

Polycarbonate window

Nickel-plated quick-disconnect connector

Black anodized aluminum mounting nut

Mounting

30 × 1.5 mm thread base mount

Optional M48 knurl nut for front mount; see ["Mounting Accessories" on page 14](#)

Connections

Integral 5-pin M12 male quick-disconnect connector

Operating Temperature

−40 °C to +50 °C (−40 °F to +122 °F)

Storage Temperature

−40 °C to +70 °C (−40 °F to +158 °F)

Environmental Rating

IP66, IP67

LED Lifetime

Lumen Maintenance - L₇₀

When operating within specifications, the output decreases less than 30% after the following time periods: 36,000 hours

Required Overcurrent Protection



WARNING: Electrical connections must be made by qualified personnel in accordance with local and national electrical codes and regulations.

Overcurrent protection is required to be provided by end product application per the supplied table.

Overcurrent protection may be provided with external fusing or via Current Limiting, Class 2 Power Supply.

Supply wiring leads < 24 AWG shall not be spliced.

For additional product support, go to www.bannerengineering.com.

Supply Wiring (AWG)	Required Overcurrent Protection (A)	Supply Wiring (AWG)	Required Overcurrent Protection (A)
20	5.0	26	1.0
22	3.0	28	0.8
24	1.0	30	0.5

Vibration and Mechanical Shock

Meets IEC 60068-2-6 requirements (Vibration: 10 Hz to 55 Hz, 1.0 mm amplitude, 5 minutes sweep, 30 minutes dwell)

Meets IEC 60068-2-27 requirements (Shock: 15G 11 ms duration, half sine wave)

Certifications



Banner Engineering BV
Park Lane, Culliganlaan 2F bus 3
1831 Diegem, BELGIUM



Turck Banner LTD Blenheim House
Blenheim Court
Wickford, Essex SS11 8YT
GREAT BRITAIN



LOW VOLTAGE LUMINAIRE
E338626



Default Indicator Characteristics

Color	Dominant Wavelength (nm) or Color Temperature (CCT)	Color Coordinates ⁽¹⁾		Lumen Output (Typical at 25 °C)
		X	Y	
Blue	450	0.1584	0.022	22
Green	520	0.1493	0.6898	161.7
Red	623	0.688	0.3043	110.7
Orange	597	0.5811	0.3812	114.3
Amber	587	0.5224	0.4228	119.4
Yellow	575	0.4435	0.4789	127.8
Lime Green	559	0.3582	0.5405	136.1
Spring Green	515	0.1499	0.6279	146.3
Cyan	495	0.1581	0.3757	119.9
Sky Blue	487	0.1554	0.2657	105.2
Violet	-	0.2358	0.1094	62
Magenta	-	0.404	0.2096	89.5
Rose	-	0.5462	0.2664	95.7
White	4000K	0.3792	0.3902	214.4

FCC Part 15 Class B for Unintentional Radiators

(Part 15.105(b)) This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

(Part 15.21) Any changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate this equipment.

Industry Canada ICES-003(B)

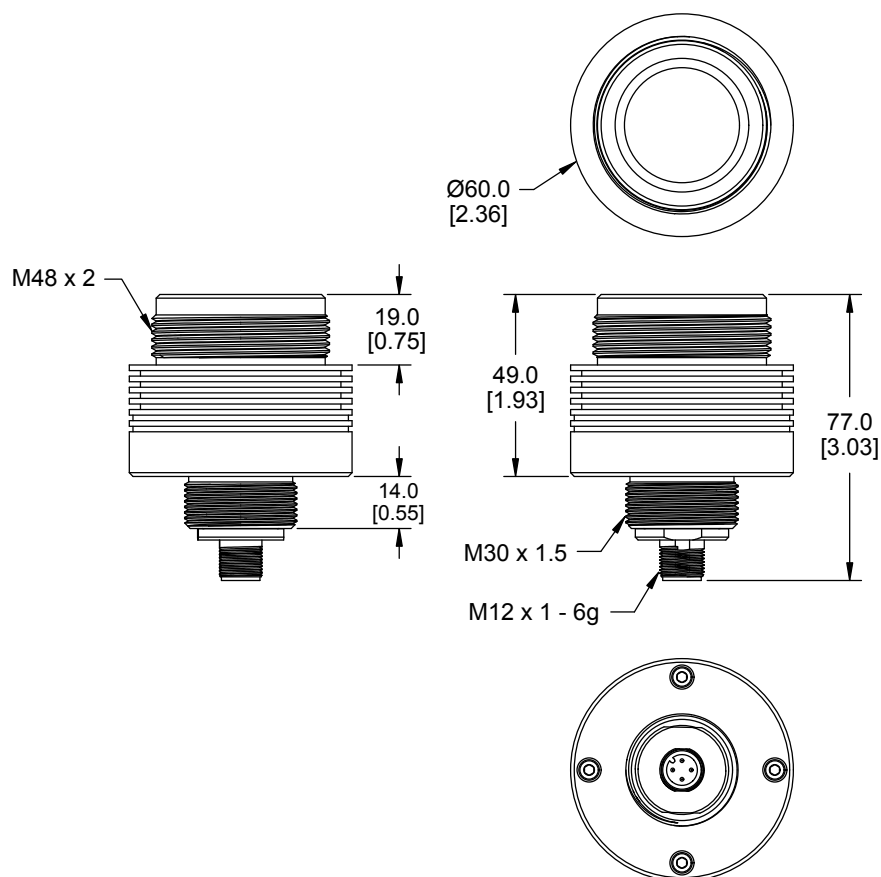
This device complies with CAN ICES-3 (B)/NMB-3(B). Operation is subject to the following two conditions: 1) This device may not cause harmful interference; and 2) This device must accept any interference received, including interference that may cause undesired operation.

Cet appareil est conforme à la norme NMB-3(B). Le fonctionnement est soumis aux deux conditions suivantes : (1) ce dispositif ne peut pas occasionner d'interférences, et (2) il doit tolérer toute interférence, y compris celles susceptibles de provoquer un fonctionnement non souhaité du dispositif.

⁽¹⁾ Refer to CIE 1931 chromaticity diagram or color chart, to show equivalent color with indicated color coordinates.

Dimensions

All measurements are listed in millimeters [inches], unless noted otherwise. The measurements provided are subject to change.



Optical Data

Performance Curves


Lux values shown are typical at 25 °C.

Distance (m)	Max Center Beam Illuminance (Lux)
	White
0.17	82,100
0.33	25,770
0.5	11,480
0.67	6,497
0.83	4,255
1	2,879

The optical data shown above is for white only. To get the lux values for other colors, multiply the values in the table above by the following factors:

Color	Multiplier
Red	0.433
Green	0.986
Blue	0.146
Cyan	0.833
Magenta	0.36
Yellow	0.709
White	1

Beam Width FWHM (mm)	Beam Angle FWHM (Deg)
300	18 (± 9°)

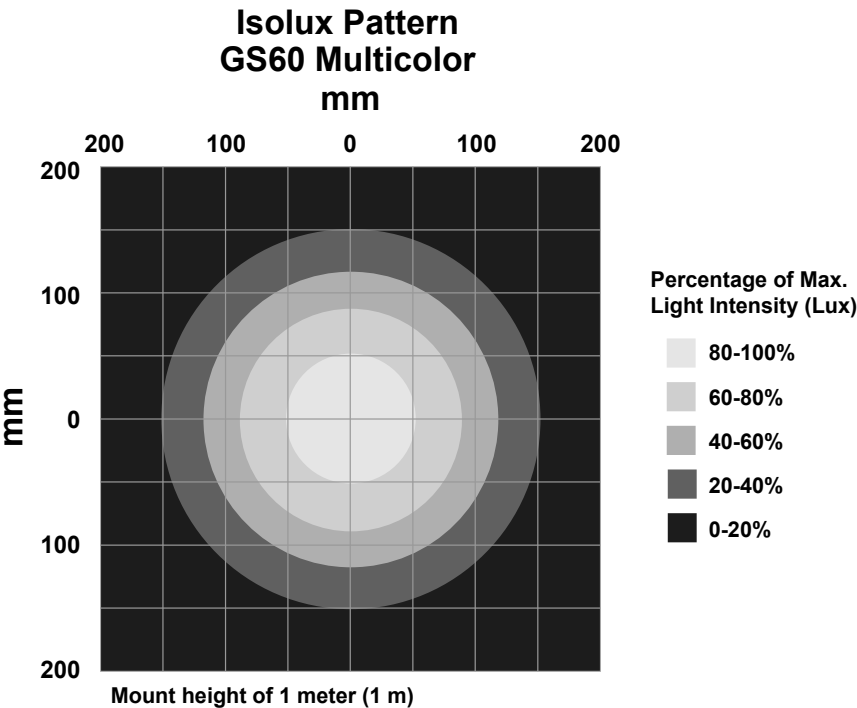

Chapter Contents

Cordsets

Mounting Accessories

Power Supplies

14




14




16

Chapter 5

Accessories


Cordsets

5-Pin Double-Ended M12 Female to M12 Male Cordsets					
Model	Length	Style	Dimensions	Pinout (Male)	Pinout (Female)
MQDEC-501SS	0.31 m (1.02 ft)	Male Straight/Female Straight			
MQDEC-503SS	0.91 m (2.99 ft)			<div>1 = Brown 2 = White 3 = Blue</div>	<div>4 = Black 5 = Gray</div>
MQDEC-506SS	1.83 m (6 ft)				
MQDEC-512SS	3.66 m (12 ft)				
MQDEC-515SS	5 m (16.4 ft)				
MQDEC-530SS	9 m (29.5 ft)				
MQDEC-550SS	15 m (49.2 ft)				

5-Pin Double-Ended M12 Female to M12 Male Cordsets					
Model	Length	Style	Dimensions	Pinout (Male)	Pinout (Female)
MQDEC-501RS	0.31 m (1.02 ft)	Male Right-angle/Female Straight			
MQDEC-503RS	0.91 m (2.99 ft)			<div>1 = Brown 2 = White 3 = Blue</div>	<div>4 = Black 5 = Gray</div>
MQDEC-506RS	1.83 m (6 ft)				
MQDEC-512RS	3.66 m (12 ft)				

Mounting Accessories

All measurements are in mm.


<div>ACC-GS60 M48 Front Mount</div> <ul style="list-style-type: none">Black anodized knurl nut for panel sealingIncluded gasket should be against the product to seal the surfaceThrough-wall (near-flush) mounting to protect the product behind a wall	
--	---

SMB30A

- Right-angle bracket with curved slot for versatile orientation
- Clearance for M6 (¼ in) hardware
- Mounting hole for 30 mm sensor
- 12-gauge stainless steel

Hole center spacing: A to B=40


Hole size: A=Ø 6.3, B= 27.1 × 6.3, C=Ø 30.5

**SMB30SC**

- Swivel bracket with 30 mm mounting hole for sensor
- Black reinforced thermoplastic polyester
- Stainless steel mounting and swivel locking hardware included

Hole center spacing: A=Ø 50.8


Hole size: A=Ø 7.0, B=Ø 30.0

**SMB30FA**

- Swivel bracket with tilt and pan movement for precise adjustment
- Mounting hole for 30 mm sensor
- 12-gauge 304 stainless steel
- Easy sensor mounting to extrude rail T-slot
- Metric- and inch-size bolt available

Bolt thread: SMB30FA, A= 3/8 - 16 × 2 in; SMB30FAM10, A= M10 - 1.5 × 50


Hole size: B= Ø 30.1

**SMBAMS30RA**

- Right-angle SMBAMS series bracket
- 30 mm hole for mounting sensors
- Articulation slots for 90°+ rotation
- 12-gauge (2.6 mm) cold-rolled steel

Hole center spacing: A=26.0, A to B=13.0


Hole size: A=26.8 × 7.0, B=Ø 6.5, C=Ø 31.0

**SMB30MM**

- 12-gauge stainless steel bracket with curved mounting slots for versatile orientation
- Clearance for M6 (¼ in) hardware
- Mounting hole for 30 mm sensor

Hole center spacing: A = 51, A to B = 25.4


Hole size: A = 42.6 × 7, B = Ø 6.4, C = Ø 30.1

**SMBAMS30P**

- Flat SMBAMS series bracket
- 30 mm hole for mounting sensors
- Articulation slots for 90°+ rotation
- 12-gauge 300 series stainless steel

Hole center spacing: A=26.0, A to B=13.0

Hole size: A=26.8 × 7.0, B=Ø 6.5, C=Ø 31.0



Power Supplies


PSW-24-1

- 24 V DC, 1 A Class 2 UL Listed power supply
- 100 V AC to 240 V AC 50/60 Hz input
- 2 m (6.5 ft) PVC cable with M12 quick disconnect
- Includes Type A (US, Canada, Japan, Puerto Rico, Taiwan), Type C (Germany, France, South Korea, Netherlands, Poland, Spain, Turkey), Type G (United Kingdom, Ireland, Singapore, Vietnam), and Type I (China, Australia, New Zealand) AC detachable input plugs



PSW-24-2

- 24 V DC, 2 A Class 2 UL Listed power supply
- 100 V AC to 240 V AC 50/60 Hz input
- 3.5 m (11.5 ft) PVC cable with M12 quick disconnect
- Includes Type A (US, Canada, Japan, Puerto Rico, Taiwan), Type C (Germany, France, South Korea, Netherlands, Poland, Spain, Turkey), Type G (United Kingdom, Ireland, Singapore, Vietnam), and Type I (China, Australia, New Zealand) AC detachable input plugs



Chapter Contents

Clean with Mild Detergent and Water..... 17

Repairs 17

Contact Us..... 17

Banner Engineering Corp Limited Warranty..... 17

Chapter 6 Product Support and Maintenance

Clean with Mild Detergent and Water

Wipe down the device with a soft cloth that has been dampened with a mild detergent and warm water solution.

Repairs

Contact Banner Engineering for troubleshooting of this device. **Do not attempt any repairs to this Banner device; it contains no field-replaceable parts or components.** If the device, device part, or device component is determined to be defective by a Banner Applications Engineer, they will advise you of Banner's RMA (Return Merchandise Authorization) procedure.

IMPORTANT: If instructed to return the device, pack it with care. Damage that occurs in return shipping is not covered by warranty.

Contact Us

Banner Engineering Corp. headquarters is located at: 9714 Tenth Avenue North | Plymouth, MN 55441, USA | Phone: + 1 888 373 6767

For worldwide locations and local representatives, visit www.bannerengineering.com.

Banner Engineering Corp Limited Warranty

Banner Engineering Corp. warrants its products to be free from defects in material and workmanship for one year following the date of shipment. Banner Engineering Corp. will repair or replace, free of charge, any product of its manufacture which, at the time it is returned to the factory, is found to have been defective during the warranty period. This warranty does not cover damage or liability for misuse, abuse, or the improper application or installation of the Banner product.

THIS LIMITED WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER EXPRESS OR IMPLIED (INCLUDING, WITHOUT LIMITATION, ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE), AND WHETHER ARISING UNDER COURSE OF PERFORMANCE, COURSE OF DEALING OR TRADE USAGE.

This Warranty is exclusive and limited to repair or, at the discretion of Banner Engineering Corp., replacement. **IN NO EVENT SHALL BANNER ENGINEERING CORP. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR ANY EXTRA COSTS, EXPENSES, LOSSES, LOSS OF PROFITS, OR ANY INCIDENTAL, CONSEQUENTIAL OR SPECIAL DAMAGES RESULTING FROM ANY PRODUCT DEFECT OR FROM THE USE OR INABILITY TO USE THE PRODUCT, WHETHER ARISING IN CONTRACT OR WARRANTY, STATUTE, TORT, STRICT LIABILITY, NEGLIGENCE, OR OTHERWISE.**

Banner Engineering Corp. reserves the right to change, modify or improve the design of the product without assuming any obligations or liabilities relating to any product previously manufactured by Banner Engineering Corp. Any misuse, abuse, or improper application or installation of this product or use of the product for personal protection applications when the product is identified as not intended for such purposes will void the product warranty. Any modifications to this product without prior express approval by Banner Engineering Corp will void the product warranties. All specifications published in this document are subject to change; Banner reserves the right to modify product specifications or update documentation at any time. Specifications and product information in English supersede that which is provided in any other language. For the most recent version of any documentation, refer to: www.bannerengineering.com.

For patent information, see www.bannerengineering.com/patents.

Mexican Importer

Banner Engineering de México, S. de R.L. de C.V. | David Alfaro Siqueiros 103 Piso 2 Valle oriente | San Pedro Garza García Nuevo León, C. P. 66269

81 8363.2714

