

## DXM Vibration Kit Overview

This guide provides directions for connecting Banner Engineering's Vibration Monitoring Solution to the Internet using either Banner CDS or AWS IoT Core.


This solution consists of vibration sensors connected to a DXM Series Controller running a script for setting a vibration baseline and generating alerts when an asset exceeds thresholds. For more information on the Banner Vibration Solution, please refer to the [Vibration Monitoring Application Guide](#) (p/n b\_4501558).

This guide requires that the DXM have firmware version 3.3.4 or newer. To download the latest firmware, check the software section of the [DXM Webpage](#) and use the DXM Configuration Software under **Tools > Reprogram** to load the latest firmware.

## Configure the DXM

Follow these steps to configure your DXM Controller.

1. Download, install, and launch the [DXM Configuration Software](#) (p/n b\_4496867).
2. Apply power to the DXM Wireless Controller and then connect to your computer using either the USB cable or Ethernet cable.  
Depending on the model of the DXM Wireless Controller you have, your USB and Ethernet ports may be in different places on the device. Please refer to the manual for your DXM model for more information.
3. In the configuration software, go to the **Connect to DXM** screen and connect to the DXM:
  - a. Serial (USB cable) - Choose the Comm Port from the drop-down list and click **Connect**. Use the refresh button if no comm port is showing up or working.
  - b. TCP/IP (if using Ethernet) - enter the IP address of the DXM and click **Connect**. The computer using the tool and the DXM need to be on the same network, which means either setting the IP address of the computer to match the DXM in a static setup or setting the DXM's IP address on its screen under **Software Config > Ethernet**.
4. Download the [Vibration Monitoring Configuration](#) files.
5. Go to **File > Open** and load the XML file into the configuration software.
6. Go to the **Settings > Scripting** screen and upload the ScriptBasic file (.sb file).

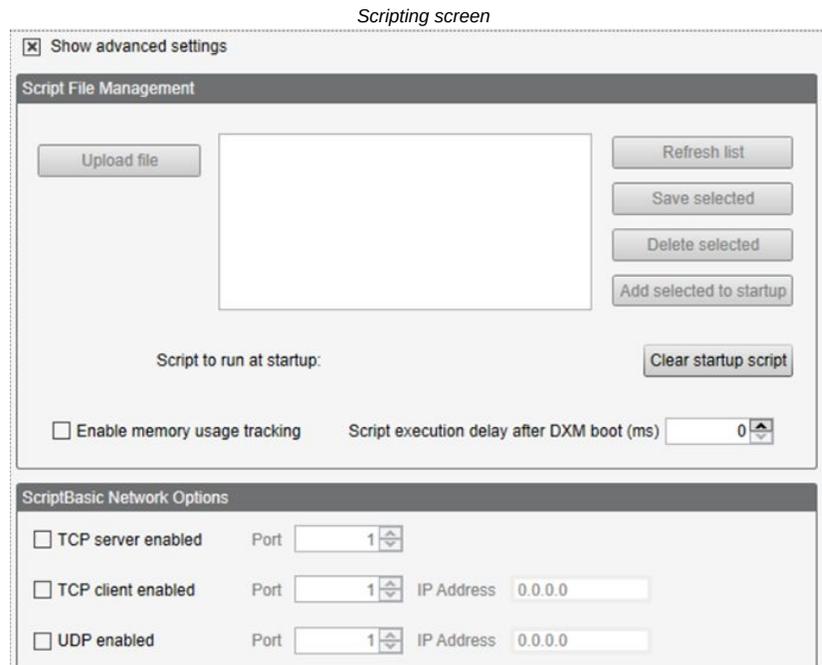

7. After the ScriptBasic file uploads, the script name appears in the box next to the **Upload file** button. Verify the name of the file matches the file listed in **Script to run at startup**.
8. Before sending the XML to the DXM, configure your system to use either Banner CDS or AWS IoT Core (see ["AWS IoT Core Quick Start Guide" on page 4](#)).

## Push Information to BannerCDS

The DXM Wireless Controller can connect to the Web via Ethernet or an internal cell module. The controller pushes data from the DXM to be stored and displayed on a website.

The Banner platform for storing and monitoring the system's data is <https://bannercds.com>. The Banner Cloud Data Services website automatically generates dashboard content for the application that is populated onto the Dashboard. Email alerts can be configured using the Alarms screen.

To push data to the cloud, change register 844 to one (1).

For more information on creating accounts on and using the Banner Cloud Data Services (CDS) system, please refer to the Banner CDS Quick Start Guide (p/n 201126).

## Logging into the Web Service

The web server captures data from the DXM using either a cellular connection or an Ethernet connection. Users collect and view the data or update and manage the DXM using a web browser.

Within a few minutes of your purchase, you will receive an email with your authorization code and details regarding the data subscription service. If the authorization code is not received within 10 minutes, please check your spam folder or contact Banner Engineering at 1-888-373-6767 to obtain the code.

Use both the website and the DXM Configuration Software to set up and configure your data collection. Use the latest version of your browser (Google Chrome is recommended) and enter the URL: <https://bannercds.com>. The login page appears.

Banner CDS home screen



## Create a New Gateway

After you log into the Banner Cloud Data Services website, the **Overview** screen displays. Follow these steps to create a new monitoring site.

1. Click on **New Gateway** (top right corner of the **Overview** screen).  
Create a new Gateway for each DXM Controller that sends data to the web server.  
A **New Gateway** prompt appears.
2. Verify **Traditional** is selected for the **Gateway Type**.
3. Enter a **Gateway Name**.
4. Select the **Company** from the drop-down list.
5. Copy the **Gateway ID** number located within the prompt window to your computer's clipboard.  
The **Gateway ID** number created by the web server is a required parameter in the configuration of the DXM. The **Gateway ID** is the address the webserver uses to store the data pushed from the DXM.
6. Click **Submit** to close the prompt window.

## Connect the DXM700 to the Software and Download the Existing Configuration

Follow these steps to connect your DXM to the configuration software and download the existing configuration file from your DXM to your hard drive.

1. On the computer, download the [DXM Configuration Software v4](#) from the Banner Engineering website and install it.
2. On the DXM: Apply power to the DXM.

3. Connect the DXM Controller to the computer with a USB cable or skip if the DXM is connected to the same network as the computer.
4. On the computer: Launch the DXM Configuration Software.
5. From the **DXM Model** drop-down list, select DXM700.
6. On the menu bar, go to **Device > Connection Settings**.
  - If you are using the USB cable, select **Serial**, then select the COM port that the USB cable is plugged into. Click **Connect**. If you are unsure which COM port and multiple appear, attempt to connect to each one of them until successful.
  - If you are connected to the same network as the DXM, select **TCP/IP** and enter the DXM IP address. Click **Connect**.
7. After the DXM is connected to the software, click **Device > Get XML configuration from DXM** to download the current XML file.
8. Name and save the file to the computer.

## Configure the DXM to Push Information to the Cloud


1. Within the DXM Configuration Software, go to the **Settings > Cloud Services** screen.
2. Set the **Server name/IP** to push.bannercds.com.
3. Select the appropriate **Push interface** to either Cellular or Ethernet.
  - To set up Ethernet, use the **Settings > Network** screen.
  - To set up cellular, refer to the [Activating a Cellular Modem](#) (p/n 205026) technical note.
4. Verify the **Gateway ID** is set to **GUID**.
5. Verify the **Push method** is set to **Cloud Push**.
6. Leave the **Cloud push interval** and **Sample count** unchanged. The DXM script controls this to push every 5 minutes.
7. In the Web Server section, keep the **Site ID** is drop-down selection as GUID and paste the copied ID from the webpage into the **Site ID** field.

## Save and Upload the Configuration File

After making any changes to the configuration, you must save the configuration files to your computer, then upload it to the device.

Changes to the XML file are not automatically saved. Save your configuration file before exiting the tool and before sending the XML file to the device to avoid losing data. If you select **DXM > Send XML Configuration to DXM** before saving the configuration file, the software will prompt you to choose between saving the file or continuing without saving the file.

1. Save the XML configuration file to your hard drive by going to the **File > Save As** menu.
2. Go to the **DXM > Send XML Configuration to DXM** menu.



- If the Application Status indicator is red, close and restart the DXM Configuration Tool, unplug and re-plug in the cable and reconnect the DXM to the software.
- If the Application Status indicator is green, the file upload is complete.
- If the Application Status indicator is gray and the green status bar is in motion, the file transfer is in progress.

After the file transfer is complete, the device reboots and begins running the new configuration.

## Upload the XML Configuration File to the Website

To upload an XML configuration file to the website, follow these instructions.

1. On the BannerCDS website, select **Gateways** on the **Overview** screen.
2. On the row displaying your **Gateway**, click the **Details** under **View**.
3. Select **Edit Gateway**.  
The **Edit Gateway** prompt appears.
4. Click **Select File** under **Update XML**.
5. Select the file that was just updated to the DXM and click **Open**.  
After the XML file is loaded into the webserver, the webserver uses the register names and configurations defined in the configuration file. The same XML configuration file is now loaded on both the DXM and the Website. After some time, the data should be seen on the website.
6. To view the data from the Gateway's screen, click on the **Details** link for each **Gateway**.  
The Gateway **Details** screen lists the **Sensor** objects and default **Alarms** for that gateway. You may view the individual register information by selecting **Registers**.

Completing these steps creates continuity between the **Gateway** created on the website with the DXM used in the field. The DXM pushes data to the website, which can be viewed at any time.

## Final Steps for the DXM Vibration Kit

After the XML configuration file has been uploaded to the DXM and to the BannerCDS website, BannerCDS automatically generates the dashboards for viewing your sensor data.

1. After the XML configuration file has been uploaded to the DXM, click **ENTER** on the DXM LCD and go into the **Registers** menu.
2. Change **CDS Cloud Push** from 0 to 1.  
Every five minutes the DXM pushes data from the Vibration Solution to the BannerCDS website dashboards.

## AWS IoT Core Quick Start Guide

This guide provides directions for connecting Banner Engineering's DXM to an AWS IoT Core instead of the Banner CDS.


This guide assumes you have access to an AWS account. If you have not yet done so, set up your AWS account and permissions. More information is available in the AWS documentation here: [Set up your AWS account](#). The relevant sections are **Sign up for an AWS account**, **Create a user and grant permissions**, and **Open the AWS IoT Console**.

For more complete information about setting up a DXM1200 Wireless Controller, refer to the instruction manual (p/n [216539](#)).

The DXM requires firmware version 3.3.4 or newer. To download the latest firmware, check the software section of the [DXM page](#) on [www.bannerengineering.com](#) and use the DXM Configuration Software under **Tools > Reprogram** to load the latest firmware.

## Create IoT Resources in AWS IoT Core

1. Go to the AWS IoT Console and create your IoT Resources in the cloud.  
You will need to create a Policy and a Thing with associated certificates and keys. Additional guidance for these steps can be found in the AWS IoT Documentation: [Create IoT Resources](#).

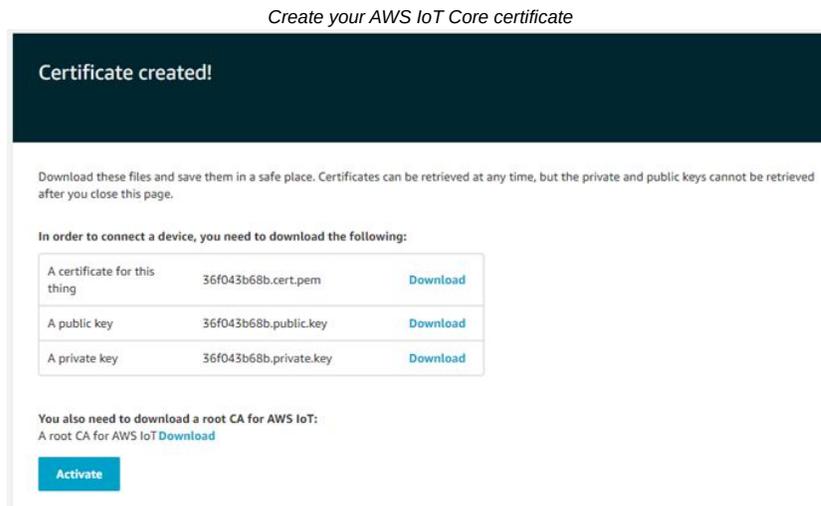

- a. On the left menu, go to **Secure > Policies** to create an AWS IoT Policy that allows your device to interact with AWS IoT.
  - b. Go to **Manage > Things**. Click **Create** and then **Create a Single Thing**.
  - c. Download the Certificate, Private Key, and Root CA for your thing. Verify your Certificate is Active.
2. Find your AWS IoT Endpoint.
    - a. To find the endpoint, go to the AWS IoT console.
    - b. In the navigation pane, select **Settings**.
    - c. The endpoint can be found under **Device Data Endpoint**. It should look similar to this: xxxxxxxxxxxxxxx-ats.iot.xxxxxxxxxx.amazonaws.com.
    - d. Copy your endpoint and paste it into a safe place for future steps.

## Enable AWS IoT Push

To enable AWS IoT pushing, follow these instructions.

1. On your DXM Controller: Click **ENTER** and go to the **Registers** menu.
2. Change **AWS IoT Push** from 0 to 1.
3. Verify **CDS Cloud Push** is set to zero.
4. On the DXM Configuration Software: With the XML loaded in the configuration software, go to the **Settings > Cloud Services** screen.

Cloud Settings screen for AWS

5. Change the **Push method** to **AWS IoT Core**.
6. Enter the **Thing Endpoint** from the AWS IoT Core Console (also called the Device Data Endpoint).
7. Upload the **Certificates** and **Keys** that you downloaded from AWS ("[Create IoT Resources in AWS IoT Core](#)" on page 4).
  - a. Use the Certificate File **Select** button to select the Certificate generated from the creation of your Thing.
  - b. Use the Private Key File **Select** button to select the Private Key generated from the creation of your Thing.
  - c. Use the Root CA File **Select** button to select the Root CA File.
8. (Optional) Modify the **ID Name** for reference if you are using multiple DXM Controllers.
9. (Optional) Go to the **Settings > AWS IoT Core** screen.

AWS IoT Core configuration screen

10. (Optional) Create **Topic** names under **Subscribe** or **Publish**. Do not change the **Groups** and **Times**.
11. Do NOT adjust the **Publish Timers**. The DXM Controller pushes to AWS IoT Core every five minutes from the script.
12. (**Cellular Connection Only**) If you are using a cellular connection instead of **Ethernet**, navigate to **Settings > Ethernet** and set your device's IP Address to Static IP.

## Save and Upload the Configuration File

After making any changes to the configuration, you must save the configuration files to your computer, then upload it to the device.

Changes to the XML file are not automatically saved. Save your configuration file before exiting the tool and before sending the XML file to the device to avoid losing data. If you select **DXM > Send XML Configuration to DXM** before saving the configuration file, the software will prompt you to choose between saving the file or continuing without saving the file.

1. Save the XML configuration file to your hard drive by going to the **File > Save As** menu.
2. Go to the **DXM > Send XML Configuration to DXM** menu.

Status indicator bar

Connected 192.168.0.1	VibelQ_DXR90_V2.xml	Application Status	<span style="color: green;">●</span>
Connected 192.168.0.1	VibelQ_DXR90_V2.xml	Application Status	<span style="color: green;">▬</span>
Not Connected	VibelQ_DXR90_V2.xml	Application Status	<span style="color: red;">●</span>

- If the Application Status indicator is red, close and restart the DXM Configuration Tool, unplug and re-plug in the cable and reconnect the DXM to the software.
- If the Application Status indicator is green, the file upload is complete.
- If the Application Status indicator is gray and the green status bar is in motion, the file transfer is in progress.

After the file transfer is complete, the device reboots and begins running the new configuration.

## Verify the Connection to AWS IoT

Follow these steps to verify you data is connecting with AWS IoT Core.

1. Go to the AWS IoT Core console.

2. Choose **Test** in the navigation pane.
3. Select **MQTT Test Client**.
4. Subscribe to "Expansion Kit," or whatever topics you created to publish in the DXM Configuration Software.

The DXM pushes data every five minutes on Ethernet and every 10 minutes on cellular. The manual data push on the DXM screen is only for HTTP so you will need to wait 5 minutes to validate the MQTT connection with AWS IoT Core.

For more information or instructions, please follow the instructions for the [Wireless Vibration Monitoring Solutions](#).

---

Document title: DXM Vibration Kit for AWS IoT Core Quick Start Guide  
Part number: b\_51143198  
Revision: D  
Original Instructions  
© Banner Engineering Corp. All rights reserved.