



TL50 Pro Select Process Data AOI Guide, v4

October 19th, 2023

This document covers the installation and use of an Add-On Instruction (AOI) for the Logix Designer software package from Rockwell Automation. This AOI handles cyclic IO-Link Process Data Out to a Banner TL50 Pro device via an IO-Link Master connected to an Allen-Bradley PLC. The AOI covers parsing and display of the TL50 Pro Process Data Out. The AOI has six User Defined Tag data types.

Components

Banner_TL50Select_PD_v4_AOI.L5X

AOI Packaged with the AOI

Banner_TL50Select_Adv_PD_v4

UDT Packaged with the AOI

Banner_TL50Select_Adv_PDIO_v4
Banner_TL50Select_Adv_PD_Seg_v4
Banner_TL50Select_Basic_PD_v4
Banner_TL50Select_Level_PD_v4
Banner_TL50Select_PDIO_v4
Banner_TL50Select_Run_PD_v4

Other AOIs Available Separately

Banner has AOI files for controlling other Banner IO-Link devices and for a variety of IO-Link Masters. Banner also has AOI files for easily handling Banner device Process Data.


Contents

- 1. Installation Process 1
- 2. Configuring the IO-Link Master 3
- 3. Configuring the AOI..... 4
- 4. Using the AOI..... 8
- Appendix A TL50 Pro Select Process Data..... 9
- Appendix B IO-Link Master Cheat Sheet 12


1. Installation Process

This section describes how to install the AOI in Logix Designer software.



1. Open a project.
2. In the Controller Organizer window, right-click on the Add-On Instruction folder. Select the Import Add-On Instruction option.

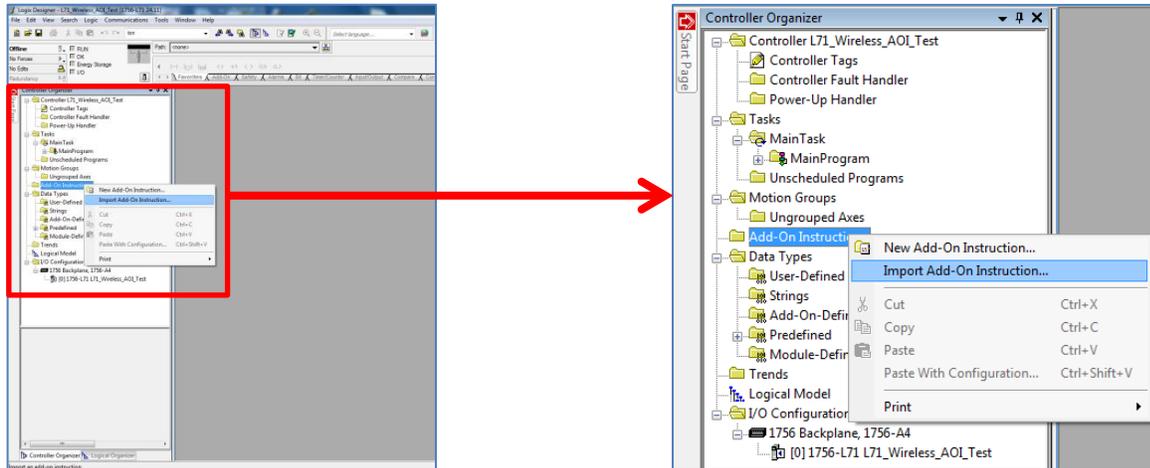

3. Navigate to the correct file location and select the AOI to be installed. In this example the “Banner_TL50Select_PD_v4_AOI.L5X” file will be selected. Click the Open button.

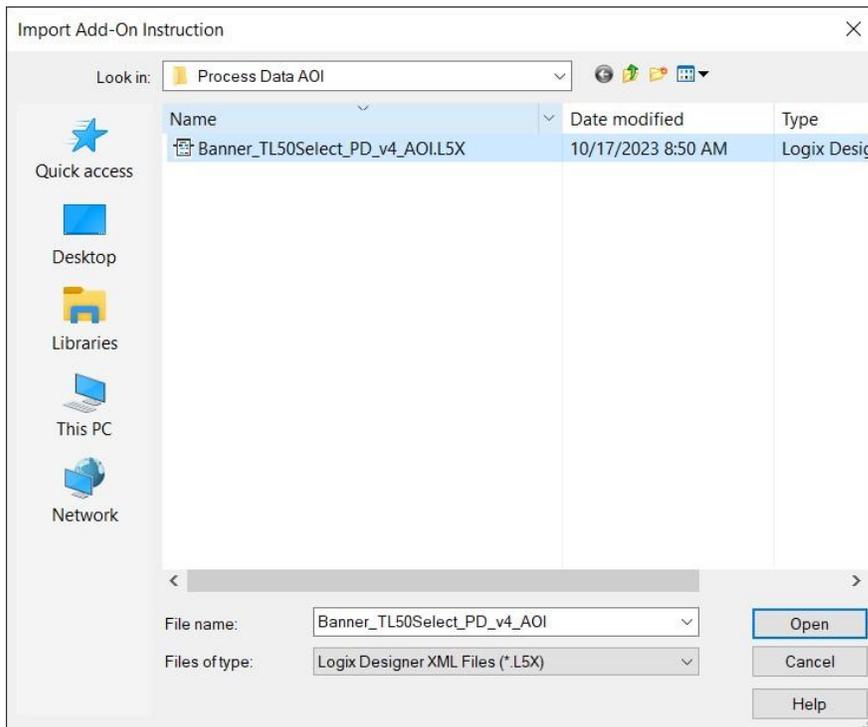

4. The Import Configuration window will pop up. The default selection will create all the necessary items for the AOI. Click the OK button to complete the import process.

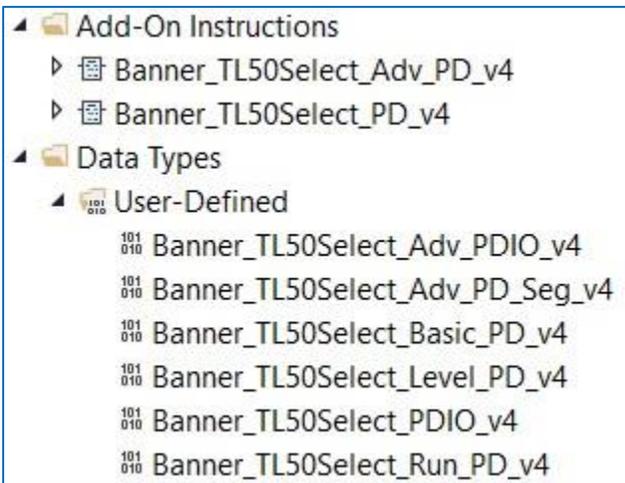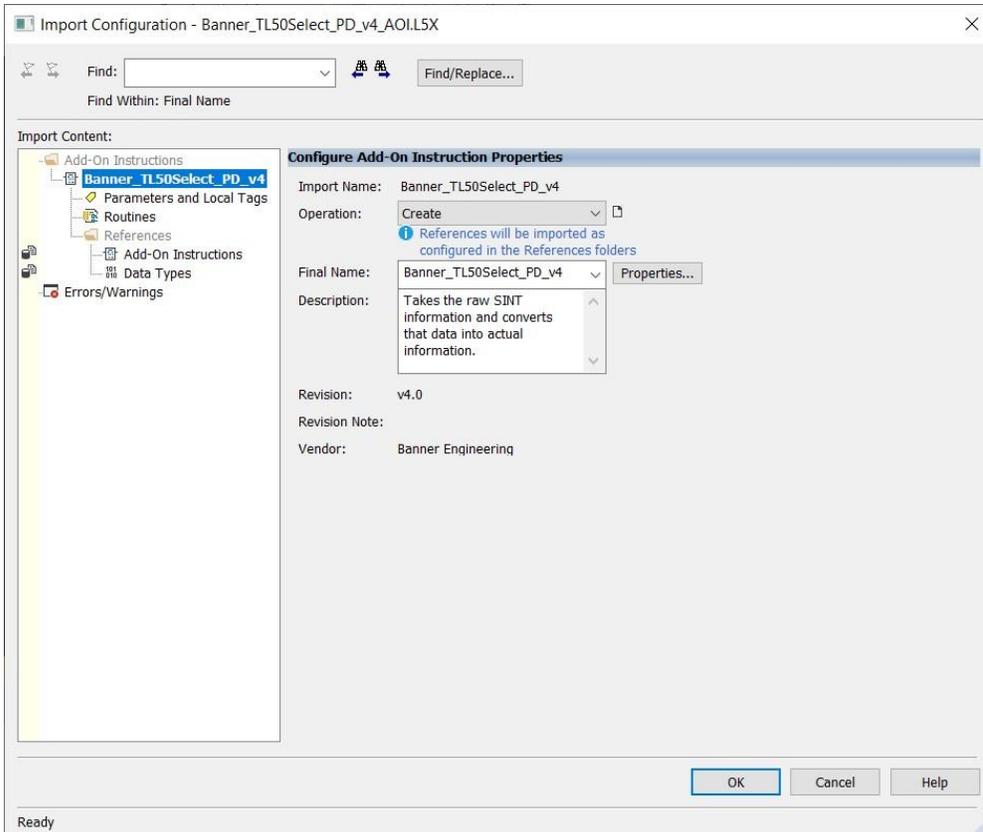

5. The AOI is added to the Controller Organizer window and should look like the picture at left.
6. AOI installation into the Logix Designer software complete.

2. Configuring the IO-Link Master

Make an EtherNet/IP connection to the IO-Link Master.

Create an Ethernet communications module for the IO-Link Master device. The controller tags generated include Input (I) and Output (O) Assembly Instances. Each Assembly has a corresponding tag array. Creating this Class 1 EtherNet/IP implicit IO connection will provide the PLC access to the IO-Link device Process Data. Each port on the IO-Link Master is given a dedicated group of I and O registers. See the relevant IO-Link Master User's Guide for more information.


3. Configuring the AOI

1. Add the “Banner_TL50Select_PD_v4” AOI to your ladder logic program. For each of the question marks shown in the instruction we need to create and link a new tag array. The AOI includes a new type of User Defined Tags (UDT): a custom array of tags meant specifically for this AOI.



2. In the AOI, right-click on the question mark on the line labeled “Banner_TL50Select_PD_v4”. Click New Tag. Name the new tag. This example uses the name “TL50Select_IOLM1_01_PD_Status”. The example naming convention accounts for this being an TL50 Pro Select device connected to IO-Link Master #1, port #1, in our program. More masters could be named IOLM2, IOLM3, and different sensors could be connected at other port numbers, etc.

Note that the Data Type is the User-Defined Data Type (UDT) entitled “Banner_TL50Select_PD_v4”. This custom-made array of registers is specially built to handle the memory needs of this AOI. Click Create to make the tag array.

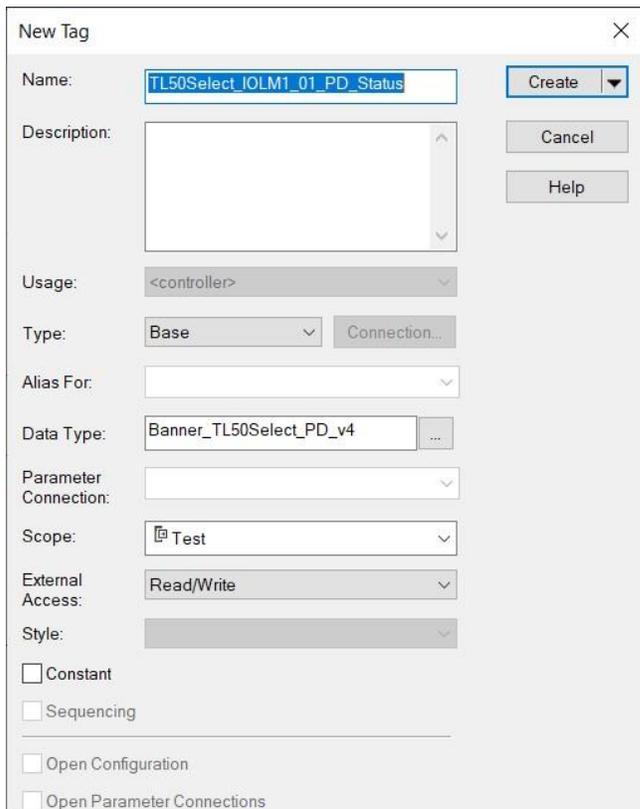

3. Now we will right-click on the question mark on the line labeled “PD” in the AOI. Click on “New Tag”. Give the tag a name. This example uses the name “TL50Pro_IOLM1_01_PD”. Notice that the Data Type is “Banner_TL50Select_PDIO_v4”. Click Create.

This array will handle the displaying of the parsed Process Data Out for the TL50 Pro device.

New Tag

Name: TL50Select_IOLM1_01_PD

Description:

Usage: <controller>

Type: Base

Alias For:

Data Type: Banner_TL50Select_PDIO_v4

Parameter Connection:

Scope: Test

External Access: Read/Write

Style:

Constant

Sequencing

Open Configuration

Open Parameter Connections



Create

Cancel

Help


- 4. The next line in the AOI is a setting to account for byte swapping. In the case of the TL50 Pro Select, the Process Data Out is 13 bytes long. IO-Link Masters may read each pair of bytes in either order, so this AOI must be ready to perform a byte swap. Enter a “0” or a “1” to toggle this setting. See Appendix B for more information.
- 5. The line labeled “Operation Mode” allows the AOI to know which of four possible Process Data Out definitions is currently in use. The choices for this setting are “0” (Basic Segment mode), “1” (Advanced Segment mode), “2” (Run mode), and “3” (Level mode). The default setting is “1”. This AOI needs to know which mode selection has been made in the device.

There are two ways to achieve this goal. We can simply type in the correct number as a constant, or we can link this TL50 Pro Select Process Data AOI to the TL50 Pro Select Parameter Data AOI. See Appendix A for more information about TL50 Pro Select Process Data.

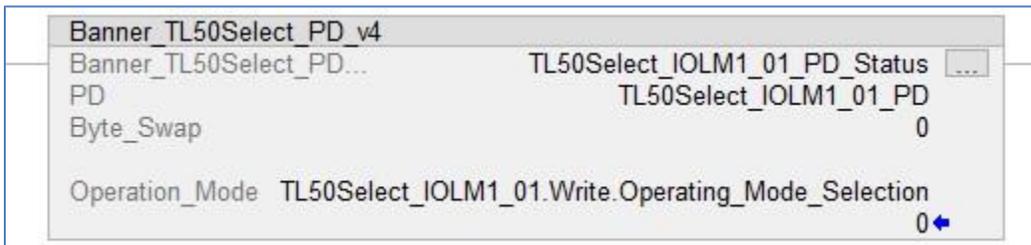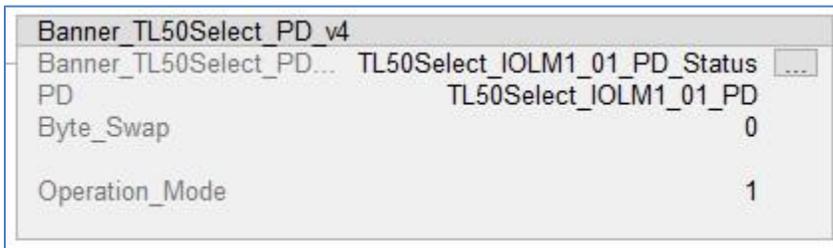


NOTE: if you type in the incorrect number (i.e., it does not match the device’s current configuration) you will get incorrectly displayed Process Data Out information.

- The final step required before we download and run the TL50 Pro Select Process Data AOI involves a File Synchronous Copy (CPS) instruction. A CPS instruction is added to the AOI rung, after the AOI. This CPS instruction is used to copy Process Data Out from the AOI into the raw Process Data Out registers used by the IO-Link Master. See Appendix B for more information. In this example, we will connect the AOI’s “Transfer_Data[0]” to the starting byte location for port 4 in the Process Data Outside. In this example, that is byte 100. The size to be copied is 14 bytes. An extra byte is sent incase byte swap is required.

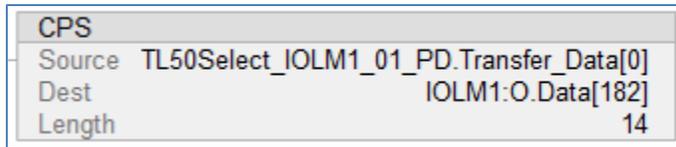


Here is what the entire rung looks like when completed.

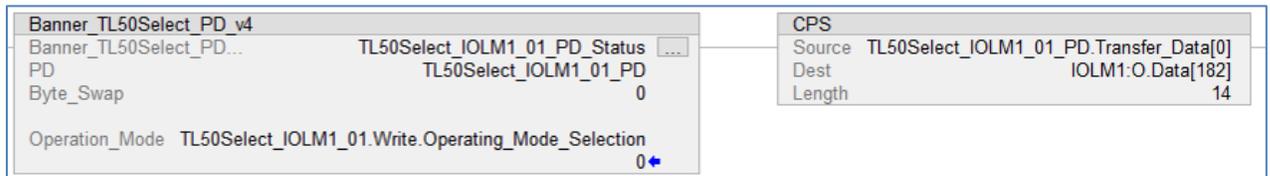

If a Banner IO-Link Master is being used, setup a Move block. Send a 1 to the Activate Outputs array value (see table for each port’s value). As an example, if port 1 needs the process data outputs active then send a 1 to 181.

| IO-Link Master Port | Activate Outputs |
|---------------------|------------------|
| 1 | 181 |
| 2 | 215 |
| 3 | 249 |
| 4 | 283 |
| 5 | 317 |
| 6 | 351 |
| 7 | 385 |
| 8 | 419 |

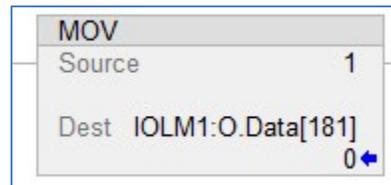

Download and Run.

The “Banner_TL50Select_PD_v4” AOI is now ready for use.

4. Using the AOI

The “Banner_TL50Select_PD_v4” Add-On Instruction has created a group of tags representing the TL50 Pro Process Data, broken out into its component parts.

Look in the Controller Tags to find the name you used above. This example used the name “TL50Select_IOLM1_01_PD”. The tag array, seen below, has individual pieces of information instead of unlabeled bits.

Each operating mode for the Process Data Out has its own tag array. If the TL50 Pro device is in operating mode “0” (Basic Segment mode), use the tags found under the “Basic_PD” array. If the operating mode is “1” (Advanced Segment mode), use the corresponding tags in the “Advanced_PD” array instead, as seen below.

| | |
|---|--|
| <ul style="list-style-type: none"> ▲ TL50Select_IOLM1_01_PD ▶ TL50Select_IOLM1_01_PD.Basic_PD ▶ TL50Select_IOLM1_01_PD.Advanced_PD ▶ TL50Select_IOLM1_01_PD.Run_PD ▶ TL50Select_IOLM1_01_PD.Level_PD ▶ TL50Select_IOLM1_01_PD.ReverseAdv_PD ▶ TL50Select_IOLM1_01_PD.Transfer_Data | <ul style="list-style-type: none"> ▲ TL50Select_IOLM1_01_PD.Advanced_PD ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_2 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_3 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_4 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Audible_State |
|---|--|

| | |
|---|--|
| <ul style="list-style-type: none"> ▲ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Color_1 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Color_1_Intensity ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Animation_Type ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Speed ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Pulse_Pattern ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Color_2 ▶ TL50Select_IOLM1_01_PD.Advanced_PD.Segment_1.Segment_Color_2_Intensity | <ul style="list-style-type: none"> {...} 0 0 0 0 0 0 0 |
|---|--|

Appendix A TL50 Pro Select Process Data

The TL50 Pro Select has 13 bytes of Process Data Out, mapped into 4 different modes, as shown below.

This Process Data is mapped to a specific group of EtherNet/IP registers. The 104-bits of Process Data encode many separate pieces of information.

This AOI intelligently parses this Process Data into its component pieces.

First is the Basic mode (mode 0). This controls the basic on/off/flash/animation state of each segment and the off/on/pulse/sos state of the audible (if present).

ProcessData id=V_PdT_Basic (condition V_Mode == 0)

ProcessDataOut "Process Data Out Basic" id=V_Pd_OutBasic

bit length: 104
data type: 104-bit Record

| subindex | bit offset | data type | allowed values | default value | acc. restr. | mod. other var. | excl. from DS | name | description |
|----------|------------|----------------|--|---------------|-------------|-----------------|---------------|---------------|--|
| 1 | 88 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Pulsed, 3 = SOS Pulse | | | | | Audible State | The state of the audible segment |
| 2 | 96 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Flash, 3 = Animation | | | | | Segment 1 | The state of the segment. Related parameters defined in Basic Segment Parameter Data |
| 3 | 98 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Flash, 3 = Animation | | | | | Segment 2 | The state of the segment. Related parameters defined in Basic Segment Parameter Data |
| 4 | 100 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Flash, 3 = Animation | | | | | Segment 3 | The state of the segment. Related parameters defined in Basic Segment Parameter Data |
| 5 | 102 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Flash, 3 = Animation | | | | | Segment 4 | The state of the segment. Related parameters defined in Basic Segment Parameter Data |

Here is the information for 1 segment (out of 4) for Advanced mode (mode 1). This mode grants the user full control over every segment of the TL50 Pro Select.

ProcessData id=V_PdT_Advanced (condition V_Mode == 1)

ProcessDataOut "Process Data Out Advanced" id=V_Pd_OutAdvanced

bit length: 104
data type: 104-bit Record

| subindex | bit offset | data type | allowed values | default value | acc. restr. | mod. other var. | excl. from DS | name | description |
|----------|------------|----------------|---|---------------|-------------|-----------------|---------------|-----------------------------|--|
| 1 | 96 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Pulsed, 3 = SOS Pulse | | | | | Audible State | The state of the audible segment |
| 2 | 92 | 3-bit UInteger | 0 = High, 1 = Low, 2 = Medium, 3 = Off, 4 = Custom | | | | | Segment 1 Color 1 Intensity | The Intensity of Color 1, Custom Intensity defined in Parameter Data |
| 3 | 88 | 4-bit UInteger | 0 = Green, 1 = Red, 2 = Orange, 3 = Amber, 4 = Yellow, 5 = Lime Green, 6 = Spring Green, 7 = Cyan, 8 = Sky Blue, 9 = Blue, 10 = Violet, 11 = Magenta, 12 = Rose, 13 = White, 14 = Custom 1, 15 = Custom 2 | | | | | Segment 1 Color 1 | The main color of the Animation. Custom Colors are defined in Parameter data |
| 4 | 85 | 3-bit UInteger | 0 = Normal, 1 = Strobe, 2 = Three Pulse, 3 = SOS, 4 = Random | | | | | Segment 1 Pulse Pattern | The pattern of Animation |
| 5 | 83 | 2-bit UInteger | 0 = Medium, 1 = Fast, 2 = Slow, 3 = Custom | | | | | Segment 1 Speed | The speed of the Animation |
| 6 | 80 | 3-bit UInteger | 0 = Off, 1 = Steady, 2 = Flash, 3 = Two Color Flash, 4 = 50/50, 5 = Intensity Sweep | | | | | Segment 1 Animation Type | The Animation type |
| 7 | 76 | 3-bit UInteger | 0 = High, 1 = Low, 2 = Medium, 3 = Off, 4 = Custom | | | | | Segment 1 Color 2 Intensity | The Intensity of Color 2, Custom Intensity defined in Parameter Data |
| 8 | 72 | 4-bit UInteger | 0 = Green, 1 = Red, 2 = Orange, 3 = Amber, 4 = Yellow, 5 = Lime Green, 6 = Spring Green, 7 = Cyan, 8 = Sky Blue, 9 = Blue, 10 = Violet, 11 = Magenta, 12 = Rose, 13 = White, 14 = Custom 1, 15 = Custom 2 | | | | | Segment 1 Color 2 | The secondary color of the Animation. Only used if Animation has two colors. Custom Colors are defined in Parameter data |

Here is Run mode (mode 2).

ProcessData id=V_PdT_RunMode (condition V_Mode == 2)
ProcessDataOut "Process Data Out Run Mode" id=V_Pd_OutRunMode

bit length: 104
 data type: 104-bit Record

| subindex | bit offset | data type | allowed values | default value | acc. restr. | mod. other var. | excl. from DS | name | description |
|----------|------------|----------------|---|---------------|-------------|-----------------|---------------|-------------------|--|
| 1 | 24 | 4-bit UInteger | 0 = Off, 1 = Steady, 2 = Flash, 3 = Two Color Flash, 4 = 50/50, 5 = Intensity Sweep, 6 = Scroll, 7 = Bounce, 8 = Color Spectrum, 9 = Demo | | | | | Animation | The Animation type |
| 2 | 32 | 4-bit UInteger | 0 = Green, 1 = Red, 2 = Orange, 3 = Amber, 4 = Yellow, 5 = Lime Green, 6 = Spring Green, 7 = Cyan, 8 = Sky Blue, 9 = Blue, 10 = Violet, 11 = Magenta, 12 = Rose, 13 = White, 14 = Custom 1, 15 = Custom 2 | | | | | Color 1 | The main color of the Animation. Custom Colors are defined in Parameter data |
| 3 | 40 | 3-bit UInteger | 0 = High, 1 = Low, 2 = Medium, 3 = Off, 4 = Custom | | | | | Color 1 Intensity | The Intensity of Color 1, Custom Intensity defined in Parameter Data |
| 4 | 48 | 2-bit UInteger | 0 = Medium, 1 = Fast, 2 = Slow | | | | | Speed | The speed of the Animation |
| 5 | 56 | 3-bit UInteger | 0 = Normal, 1 = Strobe, 2 = Three Pulse, 3 = SOS, 4 = Random | | | | | Pulse Pattern | The pattern of Animation |
| 6 | 64 | 4-bit UInteger | 0 = Green, 1 = Red, 2 = Orange, 3 = Amber, 4 = Yellow, 5 = Lime Green, 6 = Spring Green, 7 = Cyan, 8 = Sky Blue, 9 = Blue, 10 = Violet, 11 = Magenta, 12 = Rose, 13 = White, 14 = Custom 1, 15 = Custom 2 | | | | | Color 2 | The secondary color of the Animation. Only used if Animation has two colors. Custom Colors are defined in Parameter data |
| 7 | 72 | 3-bit UInteger | 0 = High, 1 = Low, 2 = Medium, 3 = Off, 4 = Custom | | | | | Color 2 Intensity | The Intensity of Color 2, Custom Intensity defined in Parameter Data |
| 9 | 88 | Boolean | false = Up, true = Down | | | | | Direction | The Direction of Animation |
| 10 | 96 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Pulsed, 3 = SOS Pulse | | | | | Audible State | The state of the audible segment |

Here is Level mode (mode 3).

ProcessData id=V_PdT_LevelMode (condition V_Mode == 3)
ProcessDataOut "Process Data Out Level Mode" id=V_Pd_OutLevelMode

bit length: 104
 data type: 104-bit Record

| subindex | bit offset | data type | allowed values | default value | acc. restr. | mod. other var. | excl. from DS | name | description |
|----------|------------|-----------------|--|---------------|-------------|-----------------|---------------|------------------|---|
| 1 | 72 | 2-bit UInteger | 0 = Off, 1 = On, 2 = Pulsed, 3 = SOS Pulse | | | | | Audible State | The state of the audible segment |
| 2 | 88 | 16-bit UInteger | | | | | | Level Mode Value | Value describing the level of the device, range determined in Level Mode Parameter Data |

Appendix B IO-Link Master Cheat Sheet

Different IO-Link Masters behave differently in several ways. For one, the register locations where Process Data is stored varies. For another, some IO-Link Masters require byte-swapping and/or word-swapping. The tables below aim to define some of these differences. Note that these numbers are when using all default settings. IO-Link Masters can change the register locations to which Process Data is mapped in response to non-default, optional settings. See relevant IO-Link Master documentation for more information.

PDI (Process Data In) is found in the IO-Link Master’s T->O (PLC “Input”) Assembly Instance.

PDO (Process Data Out) is found in the IO-Link Master’s O->T (PLC “Output”) Assembly Instance.

Table 1. First Register of Process Data “SINT0”

| Port | Allen-Bradley* | | Comtrol | | Balluff | | Turck | | ifm | | Banner | |
|------|----------------|--------------|---------|-----|---------|-----|-------|-----|-----|-----|--------|-----|
| | PDI | PDO | PDI | PDO | PDI | PDO | PDI | PDO | PDI | PDO | PDI | PDO |
| 1 | I.Ch0Data[0] | O.Ch0Data[0] | 4 | 0 | 8 | 6 | 6 | 4 | 190 | 46 | 184 | 182 |
| 2 | I.Ch1Data[0] | O.Ch1Data[0] | 40 | 32 | 56 | 38 | 38 | 36 | 222 | 78 | 218 | 216 |
| 3 | I.Ch2Data[0] | O.Ch2Data[0] | 76 | 64 | 104 | 70 | 70 | 68 | 254 | 110 | 252 | 250 |
| 4 | I.Ch3Data[0] | O.Ch3Data[0] | 112 | 96 | 152 | 102 | 102 | 100 | 286 | 142 | 286 | 284 |
| 5 | I.Ch4Data[0] | O.Ch4Data[0] | 148 | 128 | 200 | 134 | 134 | 132 | 318 | 174 | 320 | 318 |
| 6 | I.Ch5Data[0] | O.Ch5Data[0] | 184 | 160 | 248 | 166 | 166 | 164 | 350 | 206 | 354 | 352 |
| 7 | I.Ch6Data[0] | O.Ch6Data[0] | 220 | 192 | 296 | 198 | 198 | 196 | 382 | 238 | 388 | 386 |
| 8 | I.Ch7Data[0] | O.Ch7Data[0] | 256 | 224 | 344 | 230 | 230 | 228 | 414 | 270 | 422 | 420 |

*see relevant Banner Allen-Bradley IO-Link Master AOI Guide and Allen-Bradley User Guides for more information on using device IODD files to aid in integration.

Note: Murr IO-Link Masters have configurable process data. Refer to the Murr IO-Link Master Instruction Manual for Process Data mappings.

Table 2. Byte-Swap

| IO-Link Master | Byte Swap |
|----------------|-----------|
| Allen-Bradley | 0 |
| Comtrol | 1 |
| Balluff | 0 |
| Turck | 1 |
| ifm | 1 |
| Murr | 0 |
| Banner | 0 |

Specific hardware used in both tables (all default settings):

- Allen-Bradley Armor Block I/O IO-Link Master (1732E-8IOLM12R)
- Comtrol 8-EIP IO-Link Master (99608-8)
- Balluff BNI006A (BNI EIP-508-105-Z015)
- Turck TBEN-L5-8IOL
- ifm AL1122
- Murr Impact67 E DIO 12 DIO4/IOL4 4P (Art.-No. 55144)

Banner IO-Link Masters (DXMR90-4K) have a port status register. The register gives the status of the port. It gives information on if the port has an IO-Link device connected and if Process Data is valid. This is optional information but is useful for troubleshooting. The data comes into the PLC as bytes while the literature shows the value as a word. The table below gives the upper- and lower-byte data location in the PLC. The upper byte includes bits 15 through 8, while the lower byte has bits 7 through 0.

| IO-Link Master Port | Upper Bits 15 - 8 | Lower Bits 7 - 0 |
|---------------------|----------------------|---------------------|
| 1 | 182 | 183 |
| 2 | 216 | 217 |
| 3 | 250 | 251 |
| 4 | 284 | 285 |
| 5 | 318 | 319 |
| 6 | 352 | 353 |
| 7 | 386 | 387 |
| 8 | 420 | 421 |

Port Status:

Bit0 = Connected?
Bit1 = Process Data Valid?
Bit2 = Event Pending?
Bit3 = Ready for ISDU?
Bit4 = Pin4 SIO State
Bit5 = Pin2 SIO State

Bit6-7 = Pin4 Mode:
 SDCI Mode = 0
 SIO Input Mode = 1
 SIO Output Mode = 2

Bit8-10 = Pin2 Mode:
 Disabled = 0
 Input Normal = 1
 Output = 2
 Diagnostic Input = 3
 Inverted Input = 4