



R95C-4B4UI Process Data AOI Guide, v4

March 14th, 2024

This document covers the installation and use of an Add-On Instruction (AOI) for the Logix Designer software package from Rockwell Automation. This AOI handles cyclic IO-Link Process Data from a Banner R95C-4B4UI device via an IO-Link Master to an Allen-Bradley PLC.

Components

Banner_R95C_4B4UI_PD_v4_AOI.L5X

UDTs Packaged with the AOI

Banner_R95C_4B4UI_PDIO_v4

Banner_R95C_4B4UI_PDI1_v4

Banner_R95C_4B4UI_PDIO_v4

Banner_R95C_4B4UI_PD_Discrete_v4

Other AOIs Available Separately

Banner has AOI files for controlling other Banner IO-Link devices and for a variety of IO-Link Masters. Banner also has AOI files for easily handling Banner device Parameter Data.

Contents

1. Installation Process 1

2. Configuring the IO-Link Master 3

3. Configuring the AOI 4

4. Using the AOI 7


Appendix A R95C 4B4UI Process Data 8

Appendix B IO-Link Master Cheat Sheet 11


1. Installation Process

This section describes how to install the AOI in Logix Designer software.



1. Open a project.
2. In the Controller Organizer window, right-click on the Add-On Instruction folder. Select the Import Add-On Instruction option.

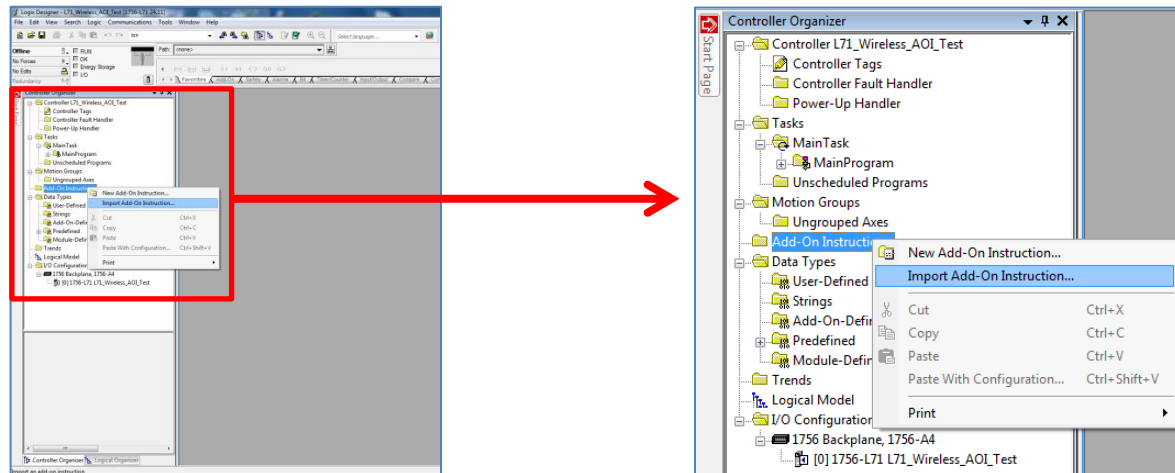

3. Navigate to the correct file location and select the AOI to be installed. In this example the "Banner_R95_4B4UI_PD_v4_AOI.L5X" file will be selected. Click the Open button.

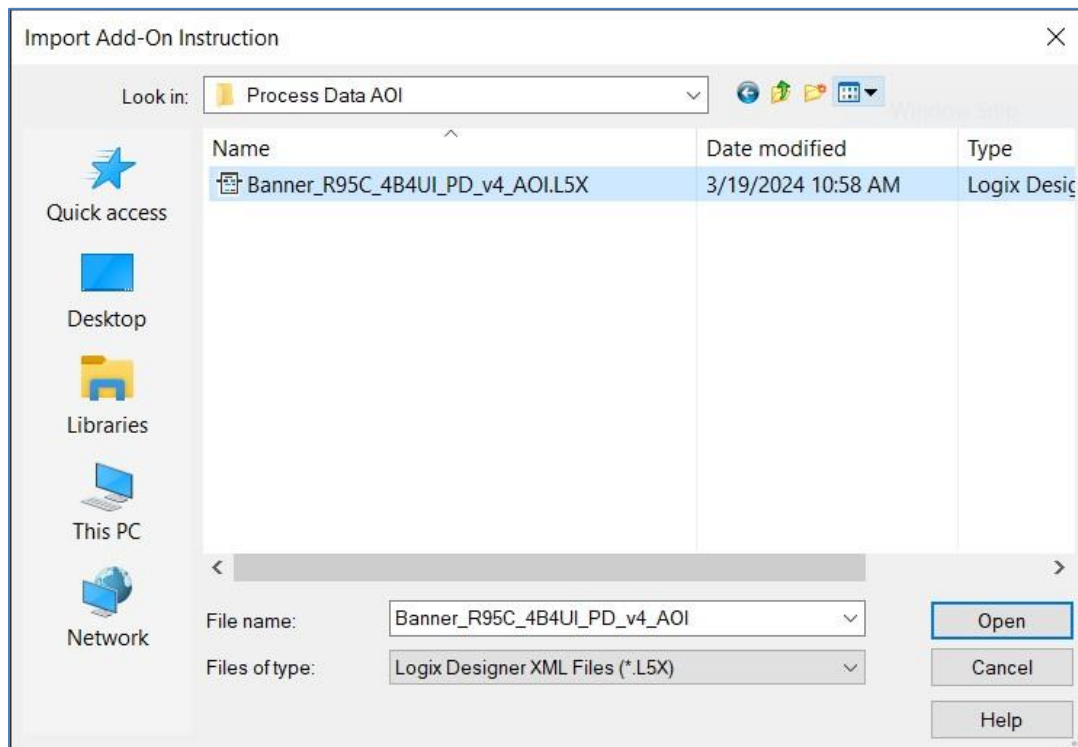

4. The Import Configuration window will pop up. The default selection will create all the necessary items for the AOI. Click the OK button to complete the import process.

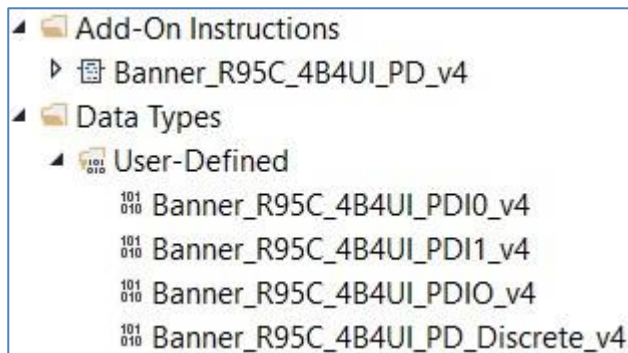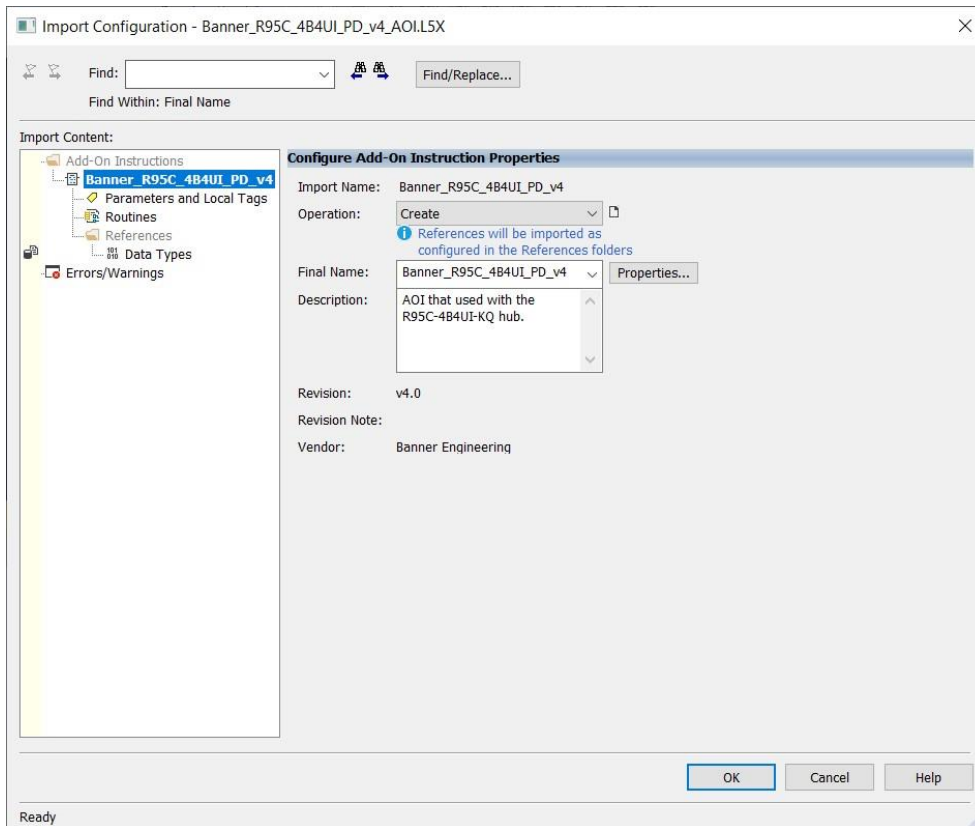

5. The AOI is added to the Controller Organizer window and should look like the picture at left.
6. AOI installation into the Logix Designer software complete.


2. Configuring the IO-Link Master

Make an EtherNet/IP connection to the IO-Link Master.

Create an Ethernet communications module for the IO-Link Master device. The controller tags generated include Input (I) and Output (O) Assembly Instances. Each Assembly has a corresponding tag array. Creating this Class 1 EtherNet/IP implicit IO connection will provide the PLC access to the IO-Link device Process Data. Each port on the IO-Link Master is given a dedicated group of I and O registers. See the relevant IO-Link Master User's Guide for more information.

3. Configuring the AOI

1. Add the “Banner_R95C_4B4UI_PD_v4” AOI to your ladder logic program. For each of the question marks shown in the instruction we need to create and link a new tag array. The AOI includes a new type of User Defined Tags (UDT): a custom array of tags meant specifically for this AOI.

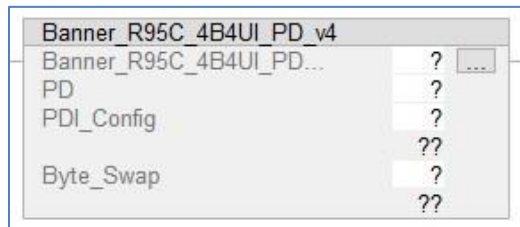

2. In the AOI, right-click on the question mark on the line labeled “Banner_R95C_4B4UI_PD_v4”. Click New Tag. Name the new tag. This example uses the name “R95C_4B4UI_IOLM1_01_PD_Status”. The example naming convention accounts for this being a R95C-4B4UI device connected to IO-Link Master #1, port #1, in our program. More masters could be named IOLM2, IOLM3, and different sensors could be connected at other port numbers, etc.

Note that the Data Type is the User-Defined Data Type (UDT) entitled “Banner_R95C_4B4UI_PD_v4”. This custom-made array of registers is specially built to handle the memory needs of this AOI. Click Create to make the tag array.

- Now we will right-click on the question mark on the line labeled “PD” in the AOI. Click on “New Tag”. Give the tag a name. This example uses the name “R95C_4B4UI_IOLM1_01_PD”. Notice that the Data Type is “Banner_R95C_4B4UI_PD_v4”. Click Create.

This array will handle the displaying of the parsed Process Data for the R95C-4B4UI.

New Tag

Name: R95C_4B4UI_IOLM1_01_PD

Description:

Usage: <controller>

Type: Base Connection...

Alias For:

Data Type: Banner_R95C_4B4UI_PDIO_v4

Parameter Connection:

Scope: Test

External Access: Read/Write

Style:

☐ Constant

☐ Sequencing

☐ Open Configuration

☐ Open Parameter Connections


Create Cancel Help

- The next line in the AOI is a setting to account for byte swapping. In the case of the R95C-4B4UI, the Process Data In is 29 bytes long and the Process Data Out is 9 bytes. IO-Link Masters may read each pair of bytes in either order, so this AOI must be ready to perform a byte swap. Enter a “0” or a “1” to toggle this setting. See Appendix B for more information.


NOTE: If the IO-Link Master you are using requires byte swapping be set to “1”.

- 5. The final step required before we download and run the R95C-4B4UI Process Data AOI involves adding two File Synchronous Copy (CPS) instructions. These instructions allow the AOI to read from and write to the raw Process Data values found in the register tags of the IO-Link Master.


Add a CPS instruction before the AOI on the ladder rung that looks like the one seen below. Refer to Appendix B for which byte to start with in the “Source” area. In this case, the IO-Link Master in question has the raw Process Data In values for a device connected to port 1 starting at byte 184. For the “Destination”, we will enter the “DTI[0]” location, as seen below. Finally, the length will be 32 bytes.

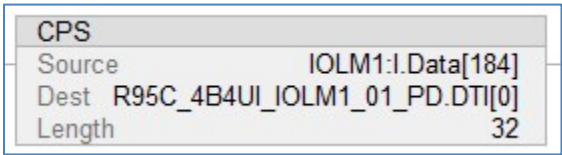

The second CPS instruction sends the Process Data Output to the correct location for the IO-Link Master. It requires a size of 10 bytes. The Source will be the DTO[0] and is linked to the output location as shown in Appendix B.

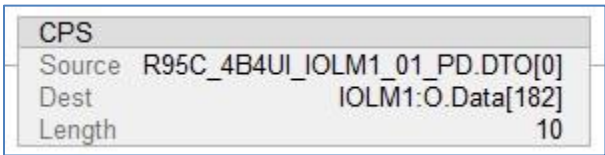


Here is what the entire rung looks like when completed.

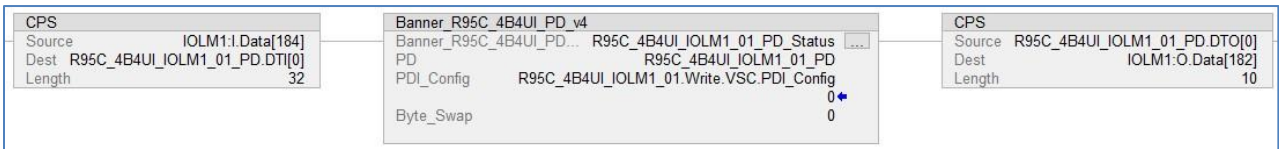

If a Banner IO-Link Master is being used, setup a Move block. Send a 1 to the Activate Outputs array value (see table for each port’s value). As an example, if port 1 needs the process data outputs active then send a 1 to 181.

IO-Link Master Port	Activate Outputs
1	181
2	215
3	249
4	283
5	317
6	351
7	385
8	419

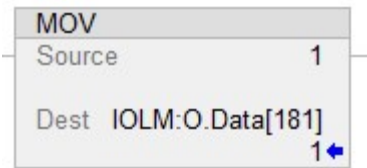

The “Banner_R95C_4B4UI_PD_v4” AOI is now ready for use.

4. Using the AOI

The “Banner_R95C_4B4UI_PD_v4” Add-On Instruction has created a group of tags representing the Process Data In, broken out into its component parts.

Look in the Controller Tags to find the name you used in Step 4 above. This example used the name “R95C_4B4UI_IOLM1_01_PD”. The tag array, seen below, shows what data the UDT has. The “Port_Data” tag stores all the information for all eight ports of the device. Expand the “Port_Data” tag.

▲ R95C_4B4UI_IOLM1_01_PD
▸ R95C_4B4UI_IOLM1_01_PD.Set0
▸ R95C_4B4UI_IOLM1_01_PD.Set1
▸ R95C_4B4UI_IOLM1_01_PD.DTI
▸ R95C_4B4UI_IOLM1_01_PD.DTO

“Port_Data” is broken out into the tags for the data set being looked at. Here data set 0 is being shown. Each item has the necessary tags stored in it.

▲ R95C_4B4UI_IOLM1_01_PD.Set0
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Analog_In
▸ R95C_4B4UI_IOLM1_01_PD.Set0.PDI_Measurement
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Discrete
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Analog_Out

The Discrete info is given for Ports 1 through 4. It gives the current On/OFF state of the discrete inputs/outputs 1 or 2. Reference the setup for the Port to know what data is used for the port. Only one of the Discrete_1_In or Discrete_1_Out can be configured.

▲ R95C_4B4UI_IOLM1_01_PD.Set0.Discrete	{...}
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Discrete.P1_DI1	1
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Discrete.P1_DI2	0
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Discrete.P2_DI1	0
▸ R95C_4B4UI_IOLM1_01_PD.Set0.Discrete.P2_DI2	0

The output tags allow the user to turn the discrete output on or off. This can only be done if discrete 1 or 2 is configured as an output via parameter data.

Appendix A R95C 4B4UI Process Data

The R95C-4B4UI has 29 bytes of Process Data In and 9 bytes of Process Data Out.

ProcessDataIn "Process Data Input" id=PD_ProcessDataIn

bit length: 232

data type: 232-bit Record (subindex access not supported)

subindex	bit offset	data type	allowed values	default value	acc. restr.	mod. other var.	excl. from DS	name	description
1	0	Boolean	false = Inactive, true = Active					Port1 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
2	1	Boolean	false = Inactive, true = Active					Port1 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
3	2	Boolean	false = Inactive, true = Active					Port2 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
4	3	Boolean	false = Inactive, true = Active					Port2 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
5	4	Boolean	false = Inactive, true = Active					Port3 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
6	5	Boolean	false = Inactive, true = Active					Port3 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
7	6	Boolean	false = Inactive, true = Active					Port4 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
8	7	Boolean	false = Inactive, true = Active					Port4 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
9	8	32-bit Integer						Process Data Measurement 1	Process Data Measurement 1 Value
10	40	32-bit Integer						Process Data Measurement 2	Process Data Measurement 2 Value
11	72	32-bit Integer						Process Data Measurement 3	Process Data Measurement 3 Value
12	104	32-bit Integer						Process Data Measurement 4	Process Data Measurement 4 Value
13	136	24-bit Integer						Measurement Value - Analog in 1	If The Mode of Analog In = Voltage, Process Data Input = value*0.001V, If The Mode of Analog In = Current, Process Data Input = value*0.000001A
14	160	24-bit Integer						Measurement Value - Analog in 2	If The Mode of Analog In = Voltage, Process Data Input = value*0.001V, If The Mode of Analog In = Current, Process Data Input = value*0.000001A
15	184	24-bit Integer						Measurement Value - Analog in 3	If The Mode of Analog In = Voltage, Process Data Input = value*0.001V, If The Mode of Analog In = Current, Process Data Input = value*0.000001A
16	208	24-bit Integer						Measurement Value - Analog in 4	If The Mode of Analog In = Voltage, Process Data Input = value*0.001V, If The Mode of Analog In = Current, Process Data Input = value*0.000001A

ProcessDataIn "Process Data Input" id=PD_ProcessDataInDMS

bit length: 232

data type: 232-bit Record (subindex access not supported)

subindex	bit offset	data type	allowed values	default value	acc. restr.	mod. other var.	excl. from DS	name	description
1	0	Boolean	false = Inactive, true = Active					Port1 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
2	1	Boolean	false = Inactive, true = Active					Port1 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
3	2	Boolean	false = Inactive, true = Active					Port2 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
4	3	Boolean	false = Inactive, true = Active					Port2 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
5	4	Boolean	false = Inactive, true = Active					Port3 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
6	5	Boolean	false = Inactive, true = Active					Port3 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
7	6	Boolean	false = Inactive, true = Active					Port4 Discrete1 Input State	true (1) = Discrete1 Input Active. Note - even if Discrete1 is configured as an output, the active state will be reflected at the input
8	7	Boolean	false = Inactive, true = Active					Port4 Discrete2 Input State	true (1) = Discrete2 Input Active. Note - even if Discrete2 is configured as an output, the active state will be reflected at the input
9	8	32-bit Integer						Process Data Measurement 1	Process Data Measurement 1 Value
10	40	32-bit Integer						Process Data Measurement 2	Process Data Measurement 2 Value
11	72	32-bit Integer						Process Data Measurement 3	Process Data Measurement 3 Value
12	104	32-bit Integer						Process Data Measurement 4	Process Data Measurement 4 Value
13	136	16-bit Integer						Measurement Value 5	The channel 5 measurement device value
14	152	7-bit Integer						Measurement Scale 5	The channel 5 measurement device scale
15	159	Boolean						SSC5.1 - Switching Signal	Indicates the detection status of an object or measurement value within a window.
16	160	16-bit Integer						Measurement Value 6	The channel 6 measurement device value
17	176	7-bit Integer						Measurement Scale 6	The channel 6 measurement device scale

ProcessDataOut "Process Data Output" id=PD_ProcessDataOut

bit length: 72

data type: 72-bit Record (subindex access not supported)

subindex	bit offset	data type	allowed values	default value	acc. restr.	mod. other var.	excl. from DS	name	description
1	0	Boolean	false = Off, true = On					Port1 Discrete1 Output State	true (1) = Discrete1 Output Active
2	1	Boolean	false = Off, true = On					Port1 Discrete2 Output State	true (1) = Discrete2 Output Active
3	2	Boolean	false = Off, true = On					Port2 Discrete1 Output State	true (1) = Discrete1 Output Active
4	3	Boolean	false = Off, true = On					Port2 Discrete2 Output State	true (1) = Discrete2 Output Active
5	4	Boolean	false = Off, true = On					Port3 Discrete1 Output State	true (1) = Discrete1 Output Active
6	5	Boolean	false = Off, true = On					Port3 Discrete2 Output State	true (1) = Discrete2 Output Active
7	6	Boolean	false = Off, true = On					Port4 Discrete1 Output State	true (1) = Discrete1 Output Active
8	7	Boolean	false = Off, true = On					Port4 Discrete2 Output State	true (1) = Discrete2 Output Active
9	8	16-bit Integer						Analog Out Value 1	If Voltage = Enter mV value, If Current = Enter uA value
10	24	16-bit Integer						Analog Out Value 2	If Voltage = Enter mV value, If Current = Enter uA value
11	40	16-bit Integer						Analog Out Value 3	If Voltage = Enter mV value, If Current = Enter uA value
12	56	16-bit Integer						Analog Out Value 4	If Voltage = Enter mV value, If Current = Enter uA value

Appendix B IO-Link Master Cheat Sheet

Different IO-Link Masters behave differently in several ways. For one, the register locations where Process Data is stored varies. For another, some IO-Link Masters require byte-swapping and/or word-swapping. The tables below aim to define some of these differences. Note that these numbers are when using all default settings. IO-Link Masters can change the register locations to which Process Data is mapped in response to non-default, optional settings. See relevant IO-Link Master documentation for more information.

PDI (Process Data In) is found in the IO-Link Master's T->O (PLC "Input") Assembly Instance.

PDO (Process Data Out) is found in the IO-Link Master's O->T (PLC "Output") Assembly Instance.

Table 1. First Register of Process Data "SINT0"

Port	Allen-Bradley*		Comtrol		Balluff		Turck		ifm		Banner	
	PDI	PDO	PDI	PDO	PDI	PDO	PDI	PDO	PDI	PDO	PDI	PDO
1	I.Ch0Data[0]	O.Ch0Data[0]	4	0	8	6	6	4	190	46	184	182
2	I.Ch1Data[0]	O.Ch1Data[0]	40	32	56	38	38	36	222	78	218	216
3	I.Ch2Data[0]	O.Ch2Data[0]	76	64	104	70	70	68	254	110	252	250
4	I.Ch3Data[0]	O.Ch3Data[0]	112	96	152	102	102	100	286	142	286	284
5	I.Ch4Data[0]	O.Ch4Data[0]	148	128	200	134	134	132	318	174	320	318
6	I.Ch5Data[0]	O.Ch5Data[0]	184	160	248	166	166	164	350	206	354	352
7	I.Ch6Data[0]	O.Ch6Data[0]	220	192	296	198	198	196	382	238	388	386
8	I.Ch7Data[0]	O.Ch7Data[0]	256	224	344	230	230	228	414	270	422	420

*see relevant Banner Allen-Bradley IO-Link Master AOI Guide and Allen-Bradley User Guides for more information on using device IODD files to aid in integration.

Note: Murr IO-Link Masters have configurable process data. Refer to the Murr IO-Link Master Instruction Manual for Process Data mappings.

Table 2. Byte-Swap

IO-Link Master	Byte Swap
Allen-Bradley	0
Comtrol	1
Balluff	0
Turck	1
ifm	1
Murr	0
Banner	0

Specific hardware used in both tables (all default settings):

- Allen-Bradley Armor Block I/O IO-Link Master (1732E-8IOLM12R)
- Comtrol 8-EIP IO-Link Master (99608-8)
- Balluff BNI006A (BNI EIP-508-105-Z015)
- Turck TBEN-L5-8IOL
- ifm AL1122
- Murr Impact67 E DIO 12 DIO4/IOL4 4P (Art.-No. 55144)

Banner IO-Link Masters (DXMR90-4K) have a port status register. The register gives the status of the port. It gives information on if the port has an IO-Link device connected and if Process Data is valid. This is optional information but is useful for troubleshooting. The data comes into the PLC as bytes while the literature shows the value as a word. The table below gives the upper- and lower-byte data location in the PLC. The upper byte includes bits 15 through 8, while the lower byte has bits 7 through 0.

IO-Link Master Port	Upper Bits 15 - 8	Lower Bits 7 - 0
1	182	183
2	216	217
3	250	251
4	284	285
5	318	319
6	352	353
7	386	387
8	420	421

Port Status:

Bit0 = Connected?

Bit1 = Process Data Valid?

Bit2 = Event Pending?

Bit3 = Ready for ISDU?

Bit4 = Pin4 SIO State

Bit5 = Pin2 SIO State

Bit6-7 = Pin4 Mode:

SDCI Mode = 0

SIO Input Mode = 1

SIO Output Mode = 2

Bit8-10 = Pin2 Mode:

Disabled = 0

Input Normal = 1

Output = 2

Diagnostic Input = 3

Inverted Input = 4